

AsBESTOS HAZARD EMERGENCY RESPONSE ACT (AHERA)
GENERAL DATA (FORM A)

LOCAL EDUCATION AGENCY Central California Conference of SDA			County Fresno
SCHOOL NAME Fresno SDA Academy			Phone number (209)251-5548
ADDRESS (number) 5397	(street) E. Olive Ave.	(city) Fresno	(zip code) 93727
CDS Code 10-62166-6933691	School Enrollment 88	# of Employees 17	# of Buildings 13

LEA AHERA DESIGNEE

NAME ESLINGER ENTERPRISES HERBERT J. ESLINGER - GILBERT D. ESLINGER			Phone number 209-387-4375
Address (number) 9545 West Hwy 152	(street)	(city) Dos Palos	(zip code) 93620
Training Course(s) & Date(s) Competent person - March 8-11 Certified Worker - March 21-25 Inspector & Mgt./Planner - May 2-6		Hours 32 40 40	Total Training hr. 112 HRS.

MANAGEMENT PLANNER

Name Herbert J.Eslinger and Gilbert D. Eslinger			Phone number 209-387-4375
Address (number) 9545 West Hwy. 152	(street)	(city) Dos Palos	(zip code) 93620
Accreditation # MP 2107 88	MP 2108 88	Training Agency Northwest Envirocon, Portland	

Documents Attached

<input checked="" type="checkbox"/> Form B	<input checked="" type="checkbox"/> Form C	<input checked="" type="checkbox"/> Form D	<input checked="" type="checkbox"/> Form E
<input checked="" type="checkbox"/> Form F	<input checked="" type="checkbox"/> Form G	<input checked="" type="checkbox"/> Form H	

We certify that the general Local Education Agency (LEA) responsibilities, as stipulated by 40CFR Part 763, have been met or will be met, and that this submission includes all buildings at this school.

Management Planner Signature >	Date 12-2-88
LEA Designee Signature >	Date 12-2-88
LEA Superintendent Signature >M.E.THORMAN, Ed. Sec.	Date 1-9-89

OFFICE OF LOCAL ASSISTANCE USE ONLY

Date Returned	Date Resubmittal Received	(date stamp)
Reason(s) For Return		
Printed Name of Reviewer		Date

ESLINGER ENTERPRISES

The following Inspection Report was completed by Herbert and Gilbert Eslinger.
Samples were taken randomly and in areas of convenience and inconspicuously according
to Sec. 763.86 of the Federal Register.

Date: 10-20-88

Herbert Eslinger
Herbert Eslinger

I-1107-88
(accreditation #)

Gilbert Eslinger
Gilbert Eslinger

I-1108-88
(accreditation #)

The holder of this card has successfully completed the training needed to comply with AHERA regulations 40 CFR 763 and TSCA Title II.

Instructor Signature

Robert E. Hastings

The holder of this card has successfully completed the training needed to comply with AHERA regulations 40 CFR 763 and TSCA Title II.

Instructor Signature

Robert E. Hastings

NOTICE

IF YOU WORK ON AN ASBESTOS REMOVAL OR ENCAPSULATION PROJECT, YOU MUST BE PREPARED AT ANY TIME TO SHOW THIS CARD TO AN INSPECTOR. YOU CANNOT LET ANYONE ELSE USE THIS CARD. YOU MUST TAKE A REFRESHER COURSE BEFORE APPLYING FOR A RENEWAL OF THIS CARD

NOT VALID UNTIL SIGNED

Gilbert Eslinger

Northwest Envirocon, Inc.



NAME
GILBERT ESLINGER
I.D.# CERT.#
I-1103-88
BIRTHDATE EXP. DATE
04/17/51 05/04/89
CERTIFICATION TYPE
ACCREDITED INSPECTOR

Northwest Envirocon, Inc.



NAME
GILBERT ESLINGER
I.D.# CERT.#
MP-2103-88
BIRTHDATE EXP. DATE
04/17/51 05/06/89
CERTIFICATION TYPE
ACCREDITED MGT/PLANNER

Department of
LABOR & INDUSTRIES

Division of
INDUSTRIAL SAFETY & HEALTH

CERTIFIED ASBESTOS WORKER



NAME
Gilbert Eslinger
CERTIFICATION NO.
E7393
CERTIFICATE NO.
3043 W
EXPIRATION DATE
04/17/51 03/25/90
JOSEPH A. DEAR, SHERIFF
Joseph A. Dear

1944

1945



NAME
HERBERT J. ESLINGER

I.D.# CERT.#
I-1107-88

BIRTHDATE EXP. DATE
12/29/22 05/04/89

CERTIFICATION TYPE
ACCREDITED INSPECTOR

NOTICE

IF YOU WORK ON AN ASBESTOS REMOVAL OR ENCAPSULATION PROJECT YOU MUST BE PREPARED AT ANY TIME TO SHOW THIS CARD TO AN INSPECTOR YOU CANNOT LET ANYONE ELSE USE THIS CARD. YOU MUST TAKE A REFRESHER COURSE BEFORE APPLYING FOR A RENEWAL OF THIS CARD

NOT VALID UNTIL SIGNED

Herbert J. Eslinger

THIS CERTIFIES THAT

HERBERT ESLINGER

has completed the required training of the Asbestos Abatement Training Program in accordance with 40 CFR 763.101. This course is a 2 day course that includes the removal of the equivalent of 100 square feet of asbestos training center.

0158 3/11/88- RANDY HALL

The holder of this card has successfully completed the training needed to comply with AHERA regulations 40 CFR 763 and TSCA Title II.

Instructor Signature

Robert E. Hastings

Department of
LABOR & INDUSTRIES

Division of
INDUSTRIAL SAFETY & HEALTH



CERTIFIED ASBESTOS WORKER



NAME
Herbert J Eslinger

CERTIFICATION NO. E6218	CERTIFICATE NO. 3042 W
BIRTHDATE 12/29/22	EXPIRATION DATE 03/25/90

JOSEPH A. DEAR, Director
Joseph A. Dear

Northwest Envirocon, Inc.



NAME
HERBERT J. ESLINGER

I.D.# CERT.#
MP-2107-88

BIRTHDATE EXP. DATE
12/29/22 05/06/89

CERTIFICATION TYPE
ACCREDITED MGT/PLANNER

The holder of this card has successfully completed the training needed to comply with AHERA regulations 40 CFR 763 and TSCA Title II.

Instructor Signature

Robert E. Hastings

Northwest ENVIROCON, Inc.

THIS CERTIFIES THAT

HERBERT ESLINGER

has completed the required training of the Asbestos Abatement Training Program in accordance with 40 CFR 763.101. This course is a 2 day course that includes the removal of the equivalent of 100 square feet of asbestos training center.

0158 3/11/88- RANDY HALL

1912

1912

1912

RECORD OF FRIABLE AND NONFRIABLE ACBM
FORM B)

9


		CDS CODE 10-62166-6933691	
SCHOOL Fresno SDA Academy		SCHOOL PHONE # (209)251-5548	
ADDRESS	(number) (street)	(city)	(zip code)
	5397 E. Olive Ave.	Fresno	93727

-IMPORTANT-

Each building and functional space with friable ACBM or friable assumed ACBM listed on this form requires completion of FORM C (PHYSICAL AND HAZARD ASSESSMENT OF FRIABLE ACBM OR FRIABLE ASSUMED ACBM).

Indicate location of material on blueprint, diagram or narrative in square or linear feet, and attach a copy (Sec. 763.93).


line	BUILDING NAME & FUNCTIONAL SPACE (indicate address if different)	CHECK ONE			CHECK ONE			
		Sur fac ing	TSI	MISC.	ACBM		ASSUMED ACBM	
					Fri able	Non fri	Fri able	Non friable
1.	59-Furnace Rm. (9-59-T)		X		X			
2.	59-Furnace Rm. (9-59-P-T)		X		X			
3.	59-Furnace Rm. (9-59-TI)		X		X			
4.	59-Furnace Rm. (9-59-G)		X		X			
5.	Bldg. 3 (9-B3-PI)		X			X		
6.	57-Storage in Bldg.3 (9-57-AS)	X				X		
7.	Arts & Music Rm. 16 (9-16a-V)			X		X		
8.								
9.								
10.								
11.								

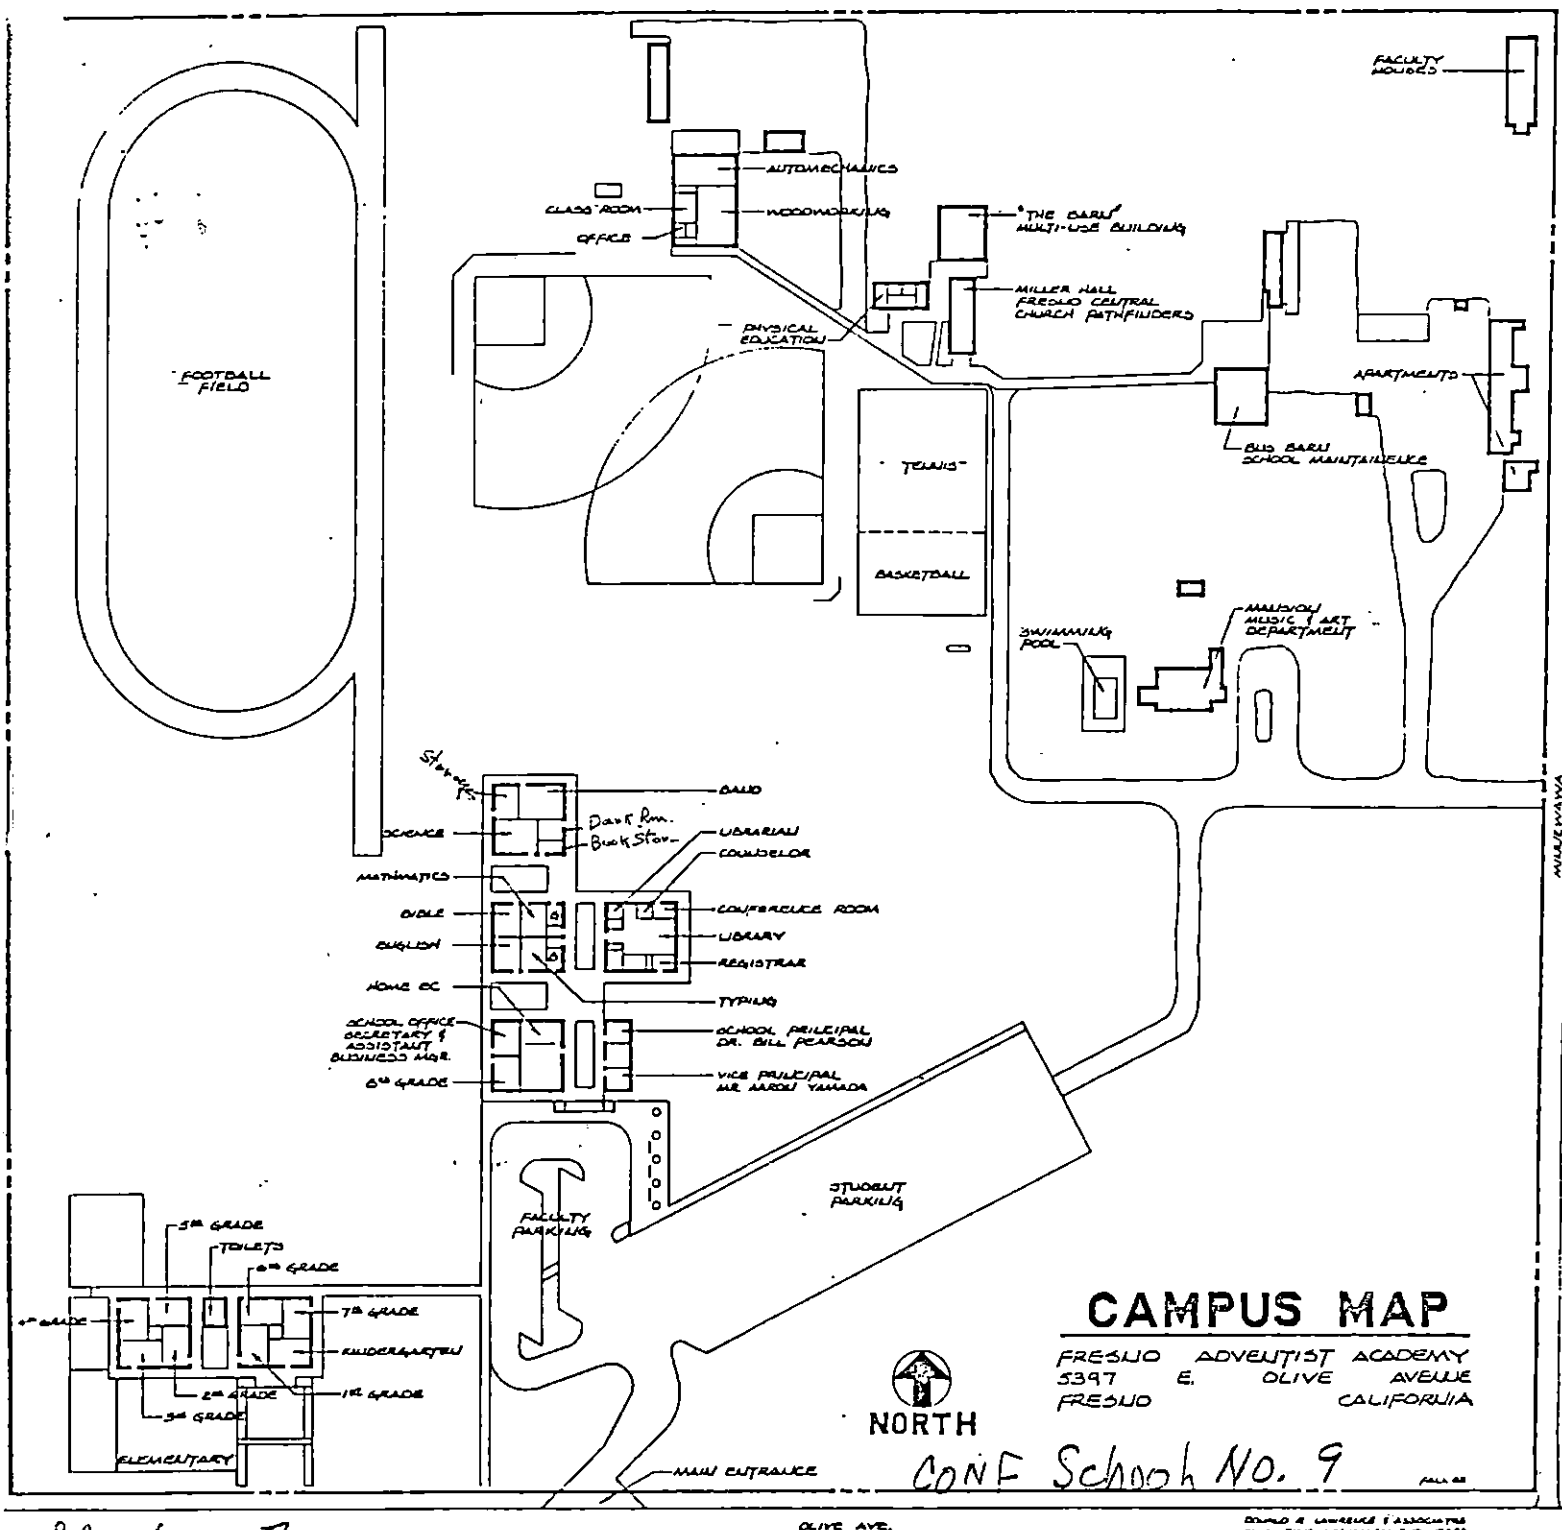


Staff - 27.
 Teachers - 88. Academy,
 Built - 5-26-72. Secondary Section
 Elementary - 211 - Built in 1968-69.
 Inspected 10:3, 4, 6



Total sqft. 47402

No 9 FRESNO SDA ACADEMY
 1st Floor ARTS. AND MUSIC BLDG
 BUILT APPROX. 1925-30
 2218 S 1st Street
 2218 S 1st Street

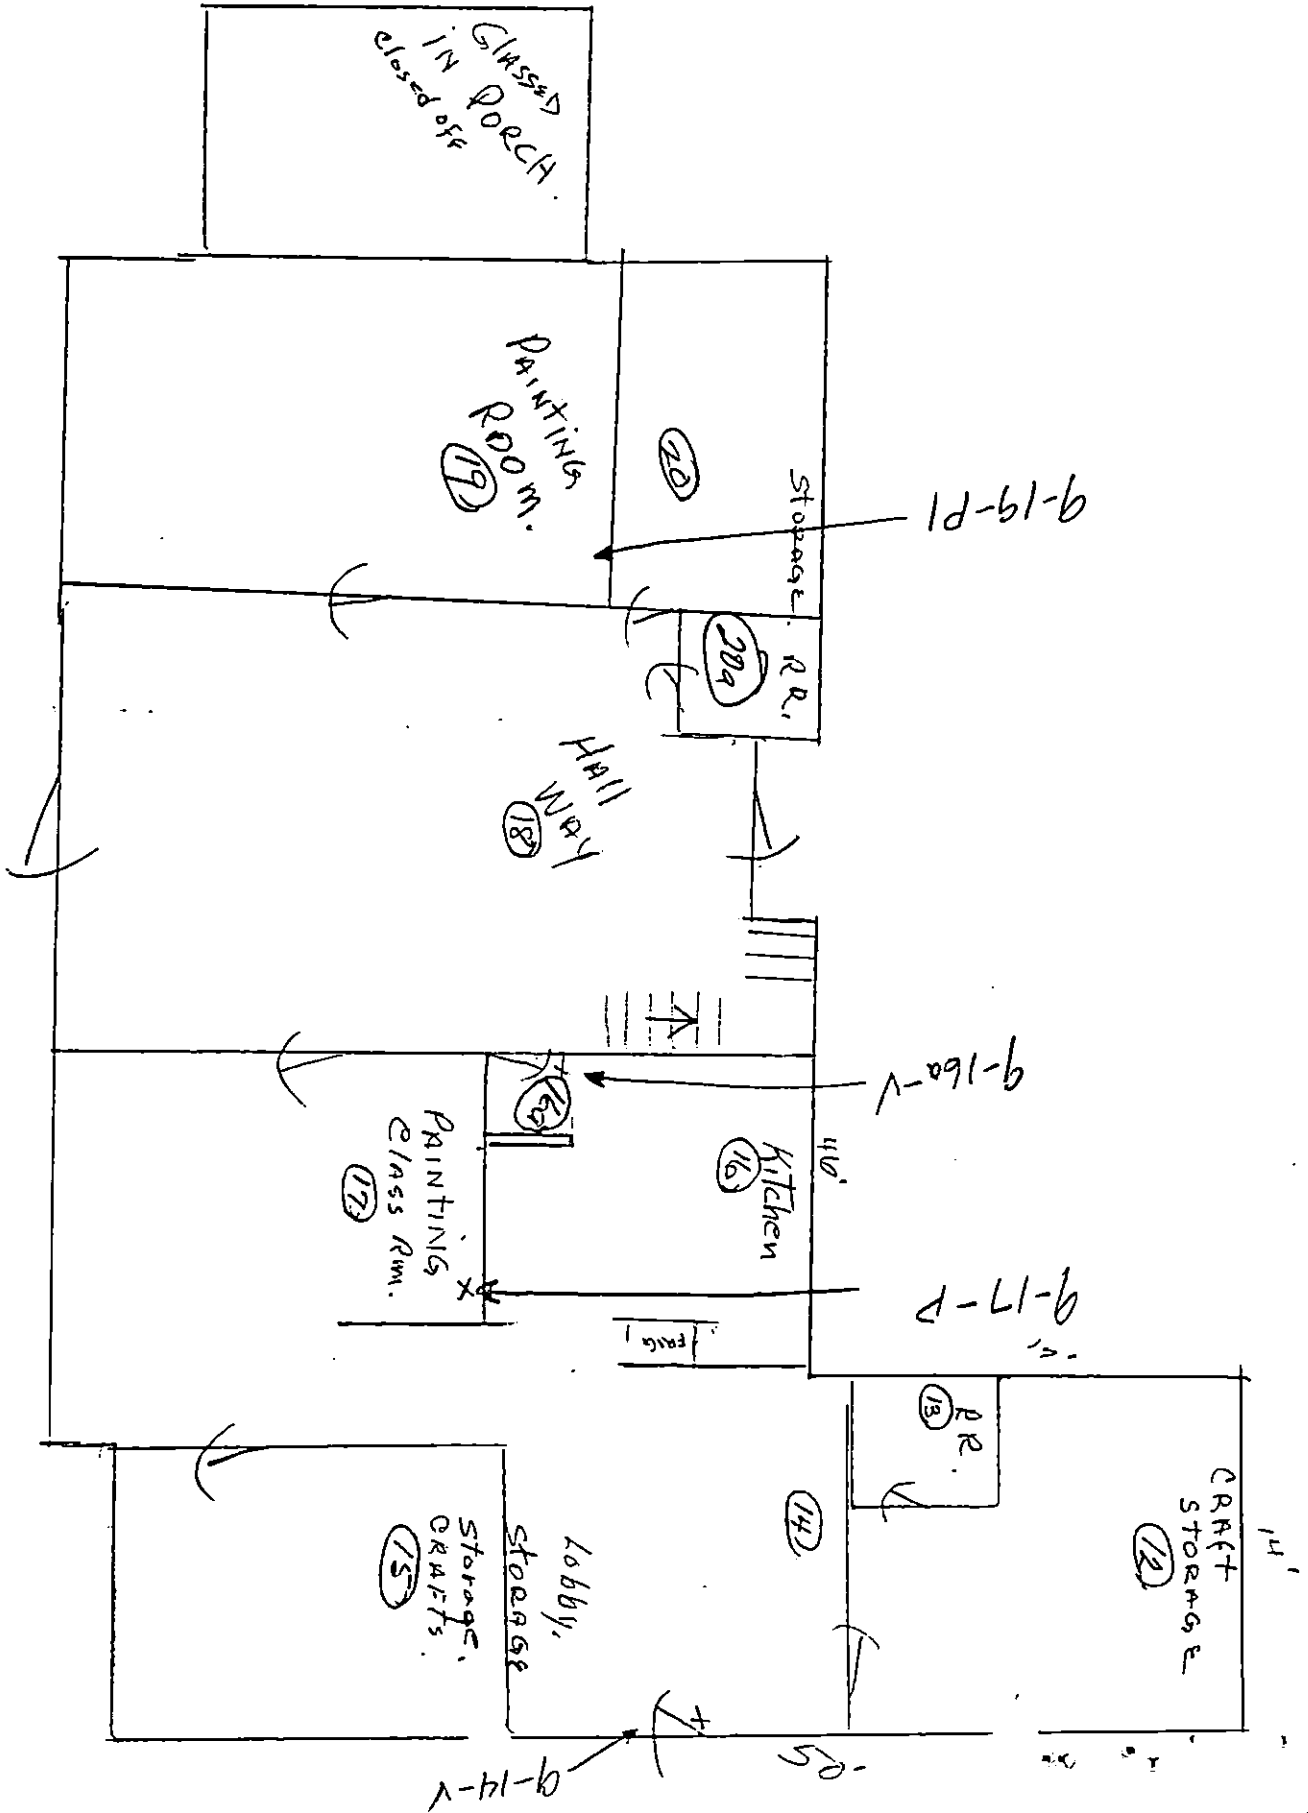


Quonset Hut
METHA.

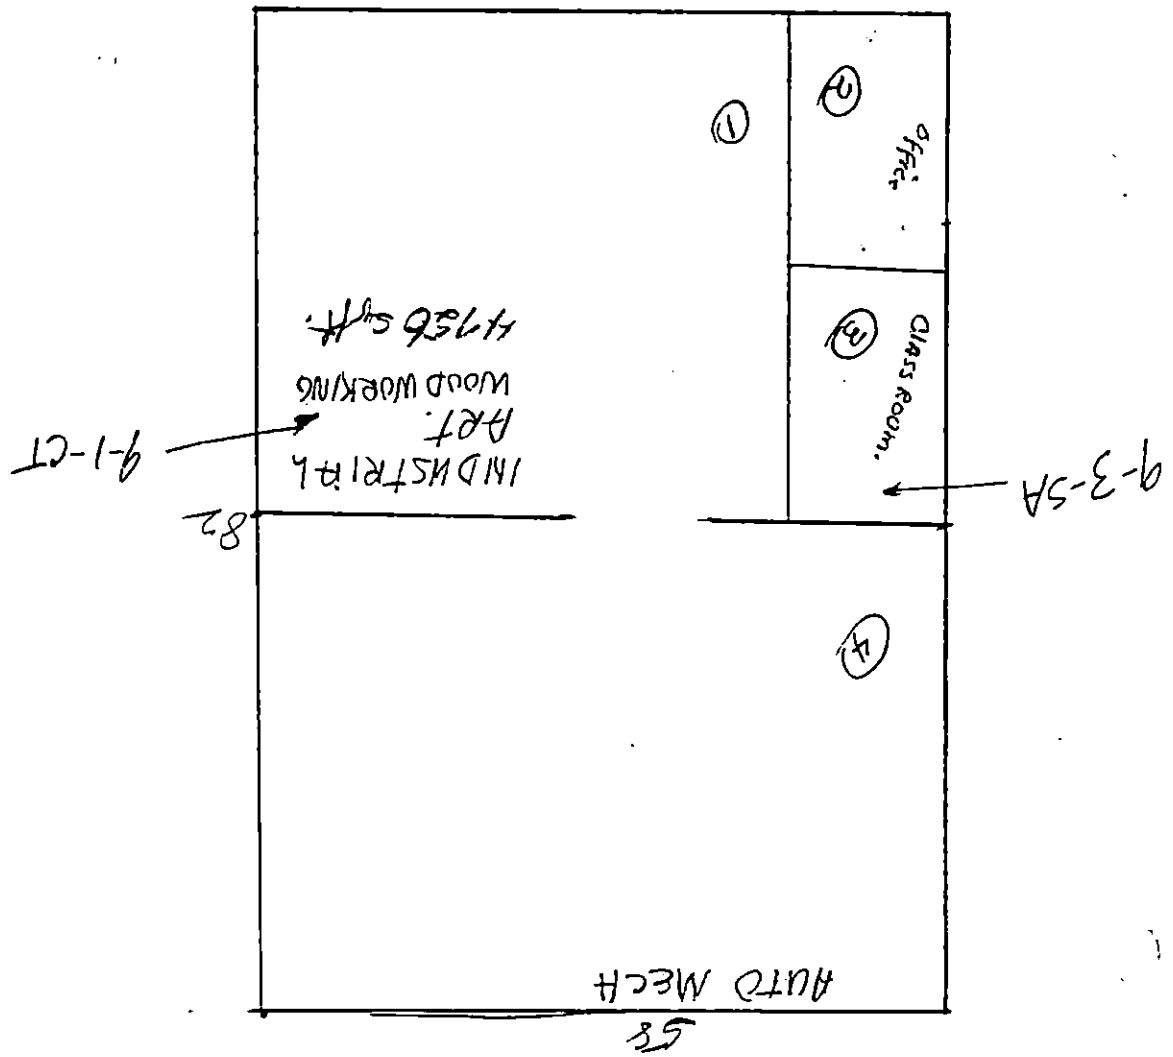


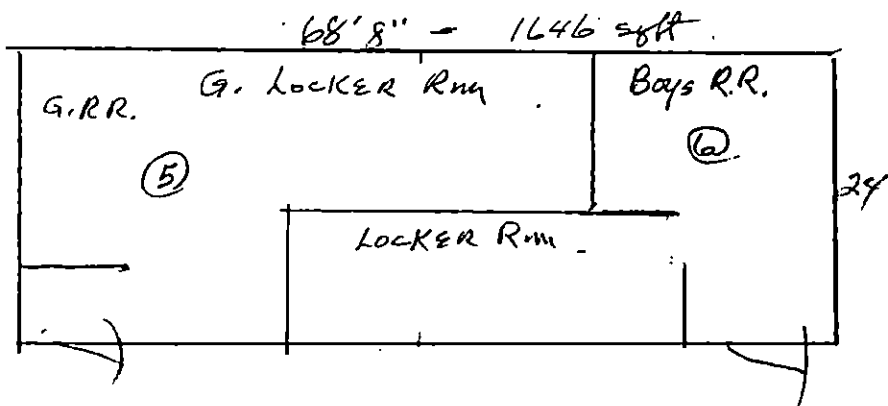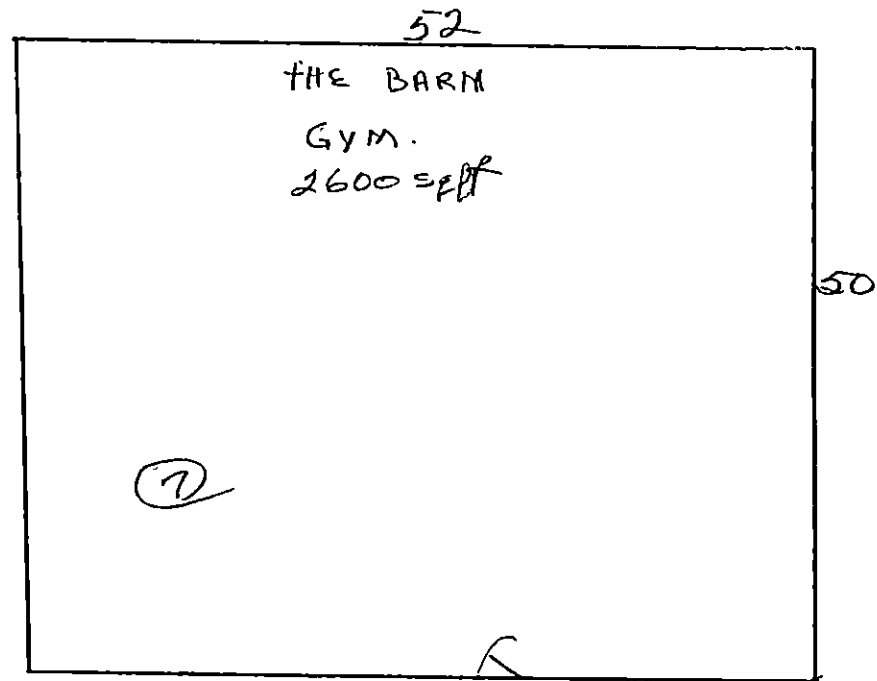

P.E. Dept.
6118 total sqft.

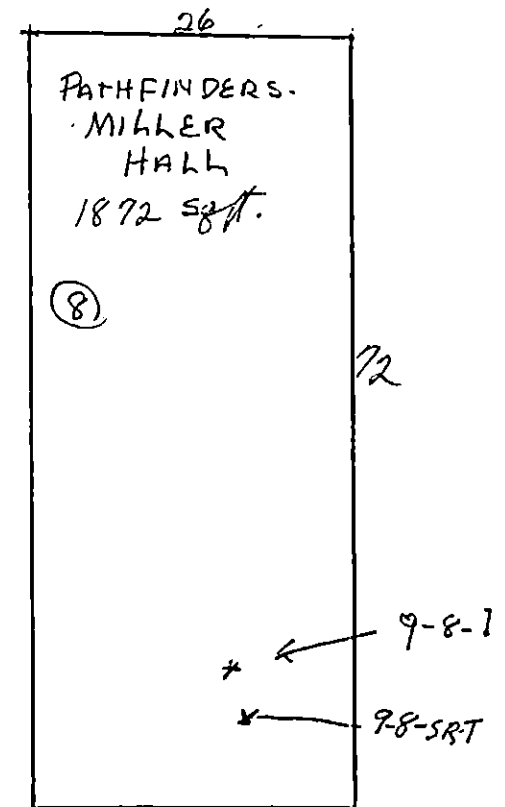


BUS MAINTENANCE SHOP.
~~4182 apt.~~
 FRESNO SDA. ACADEMY
 No. 9

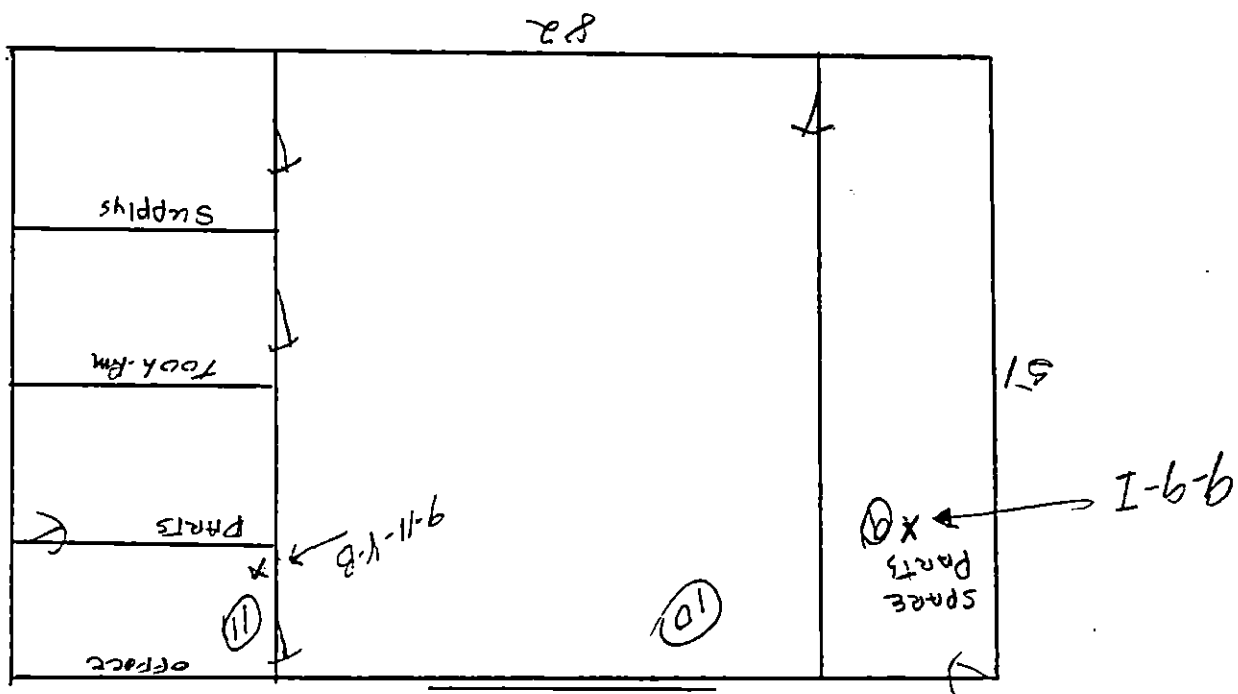

FRESNO SDA. LEVEL
 SECONDARY 88. STUDENT
 ACADEMY 1972-73.
 Total Staff - Elem - Acad. 27
 Bldg 1, 2, 3, 6 = 1638-
 5. FT
 No 9. IN CODE


9-B3-PI

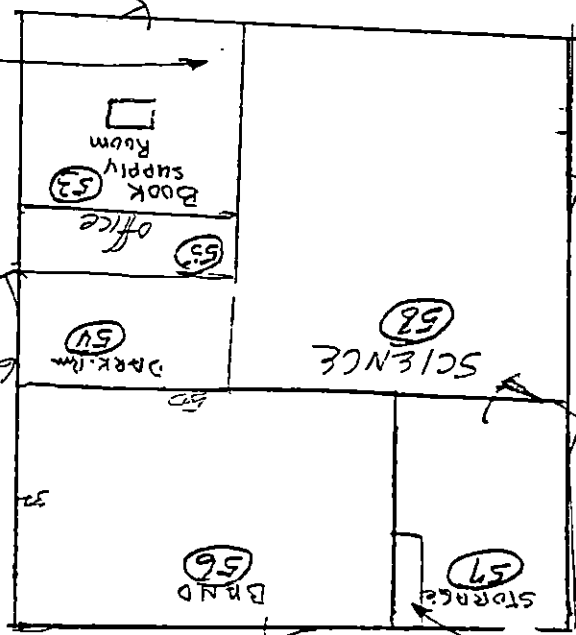

Bldg 3
 4096 S.F.

9-57-AS

46a hot water heater
 9-46a-PI

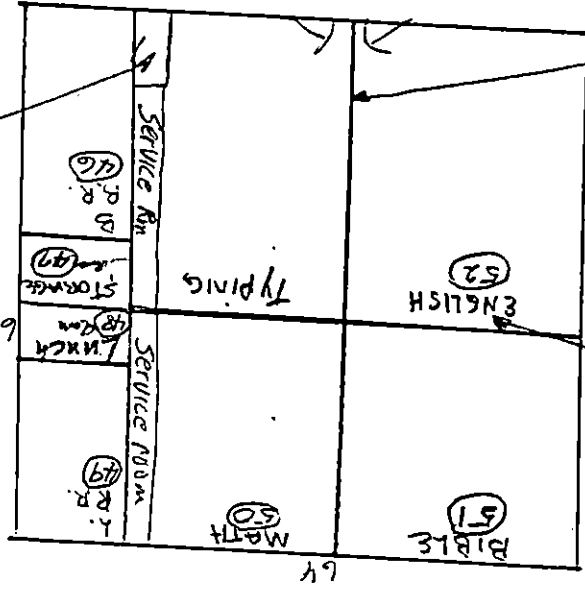


Bldg 2
 4096 S.F.


9-50-T


9-50-BB

9-44-VP

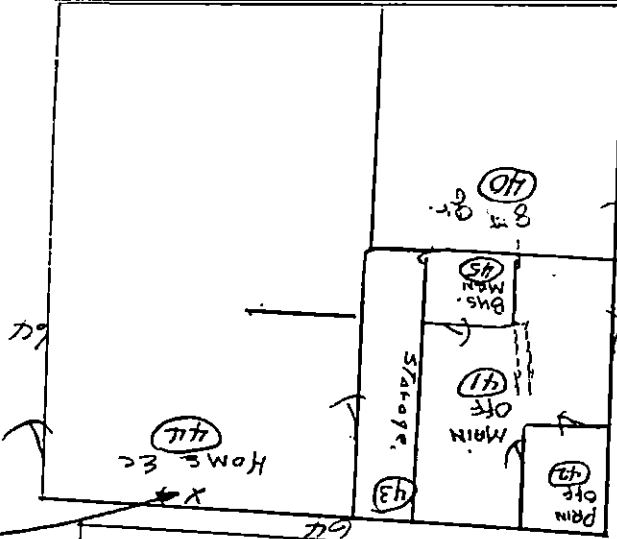



Bldg 1
 4096 S.F.





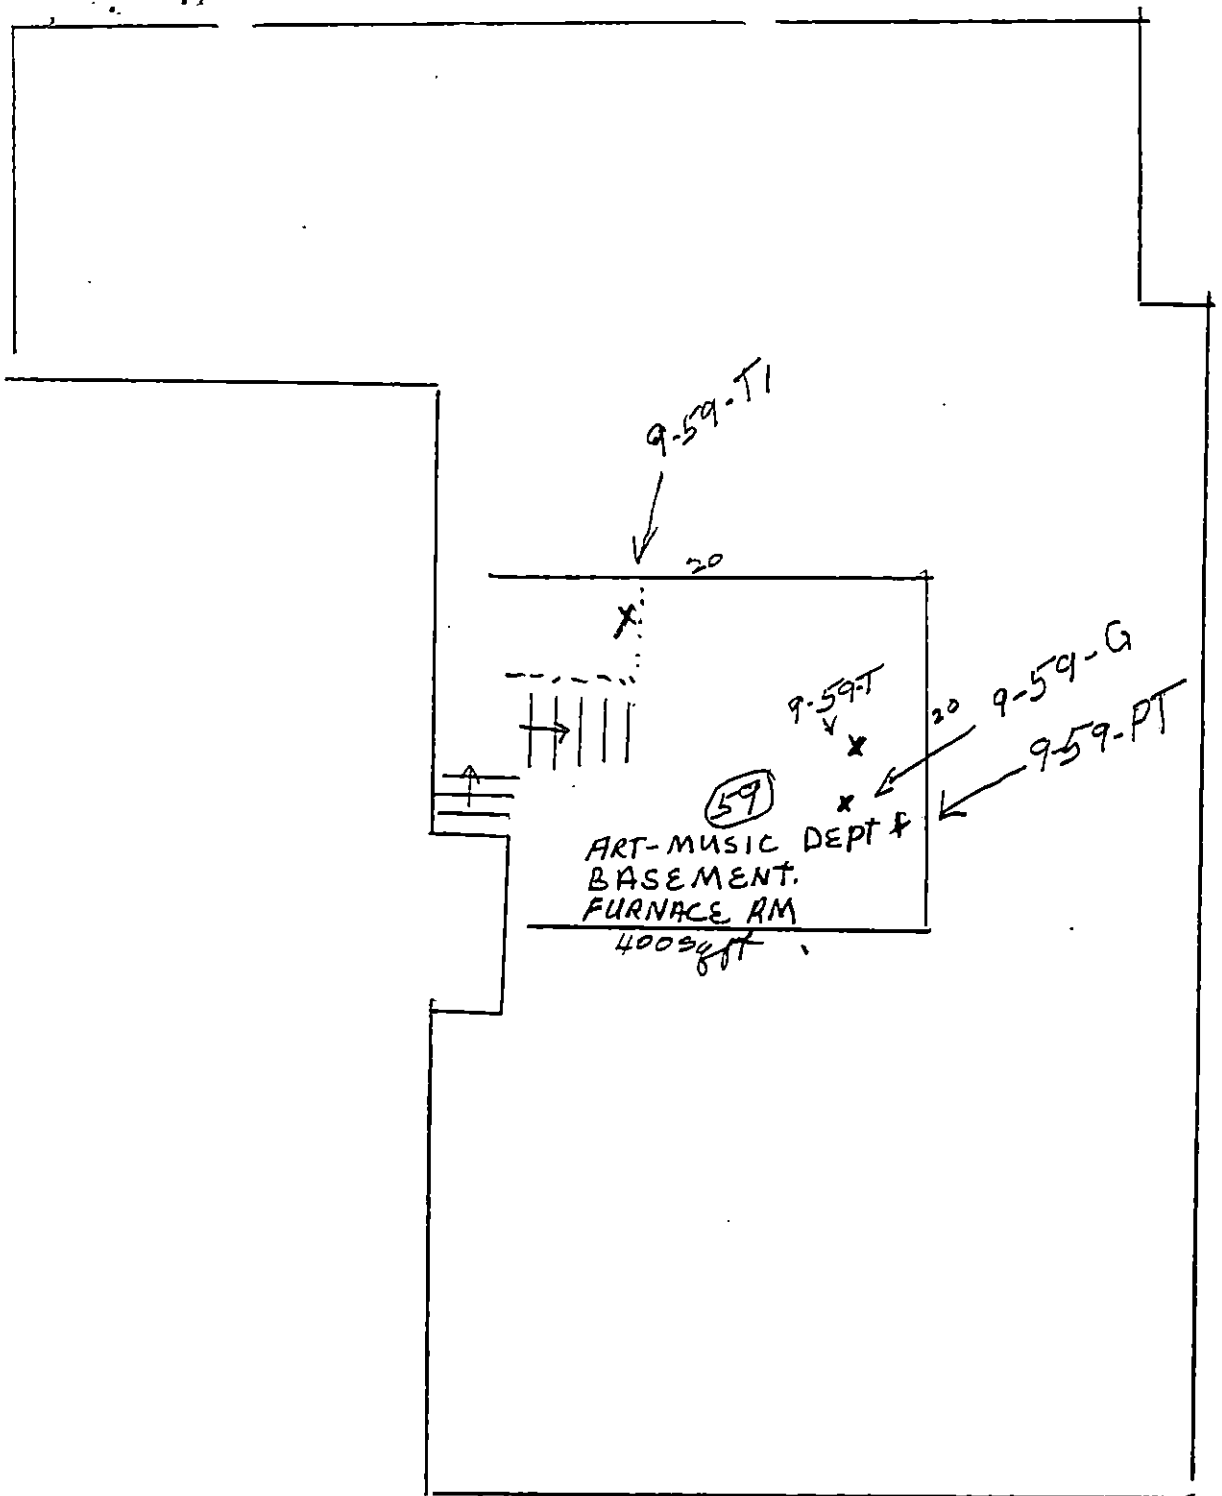


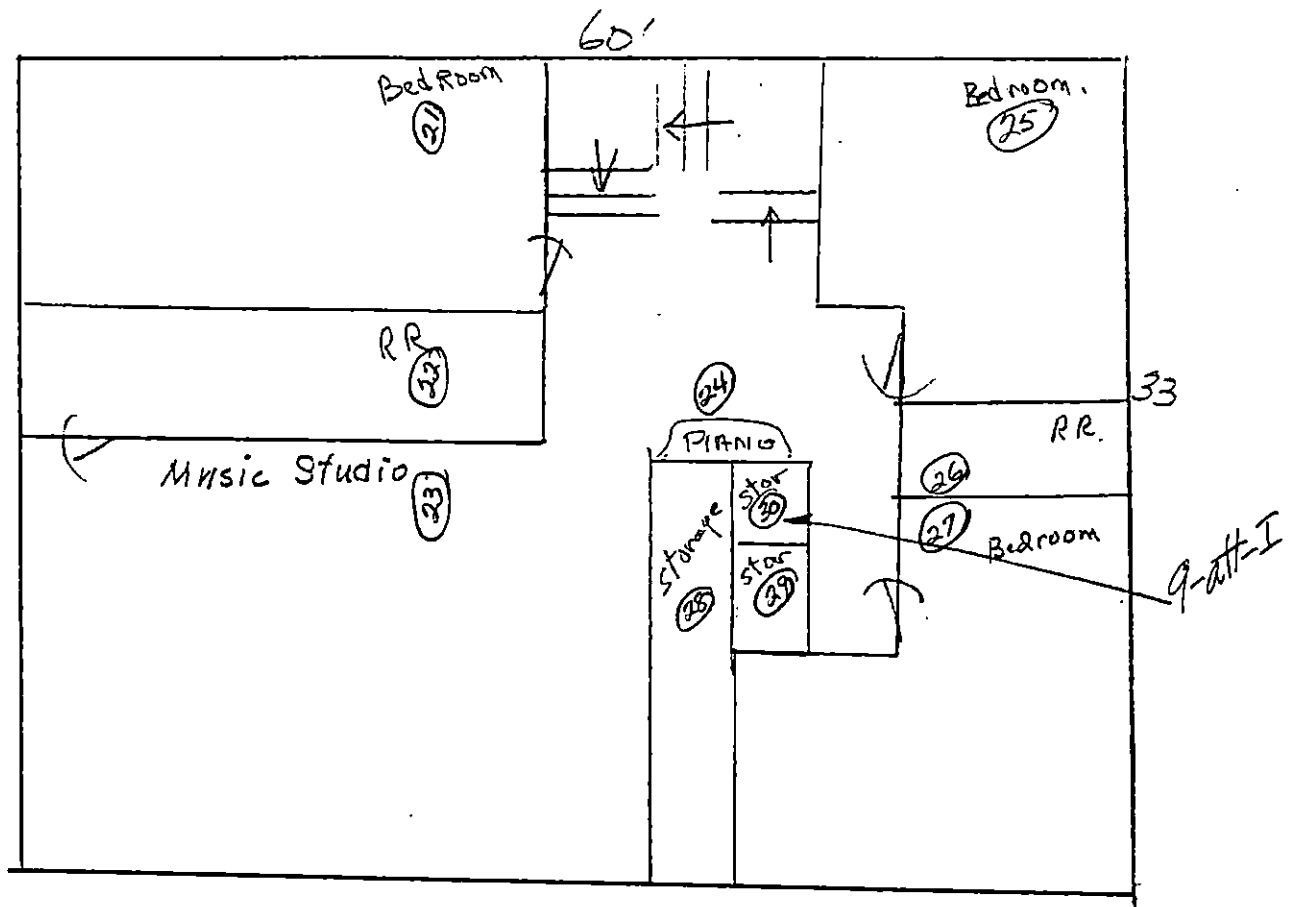

FRESNO S.D.A. ACADEMY
 ARTS AND MUSIC BLDG.
 2ND STORY
 1980 Sq. Ft. APPROX
 NO 9 IN CODE.

FRESNO SDA ACADEMY
AND ELEMENTARY
No 9 IN CODE No.

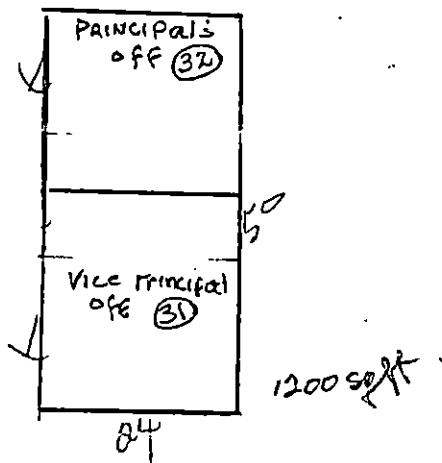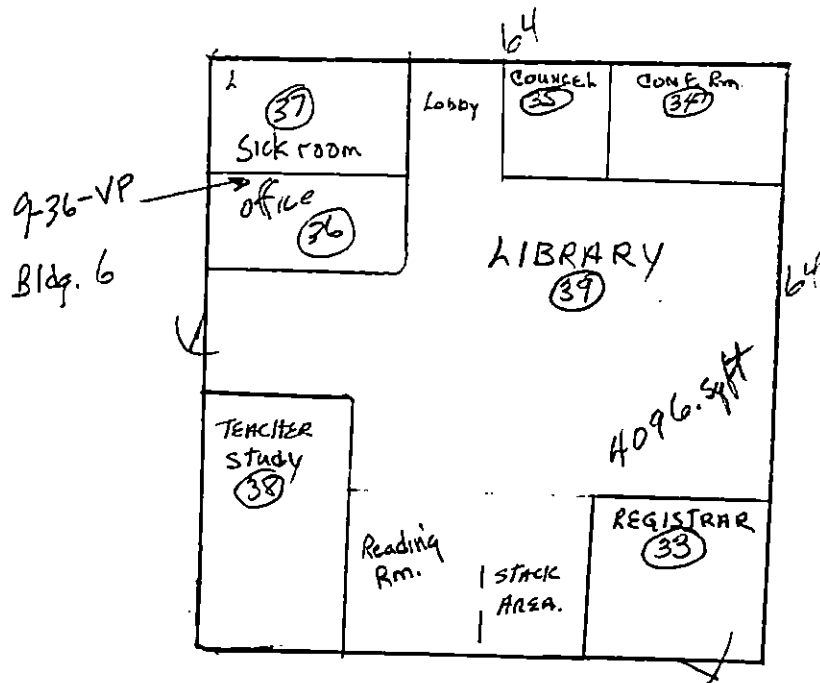

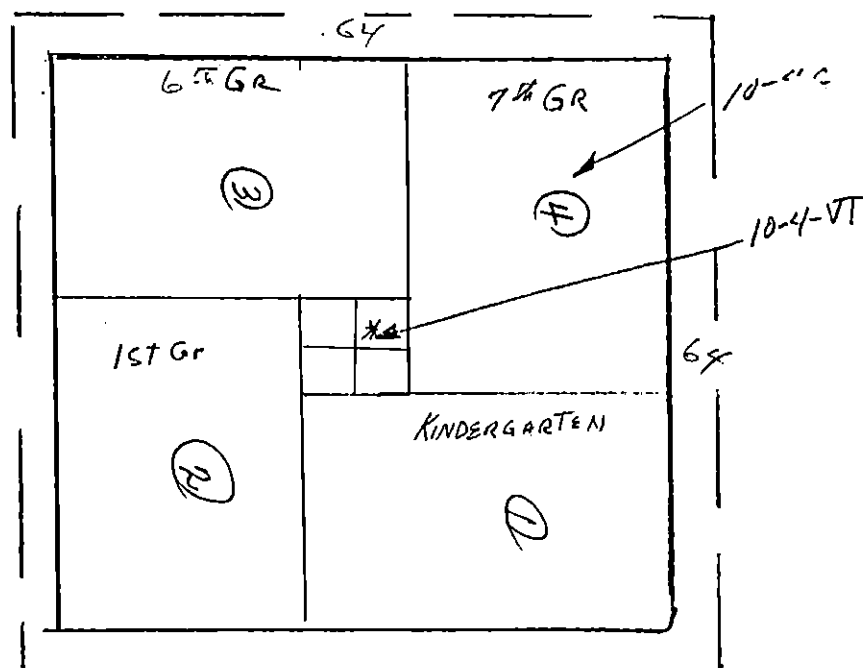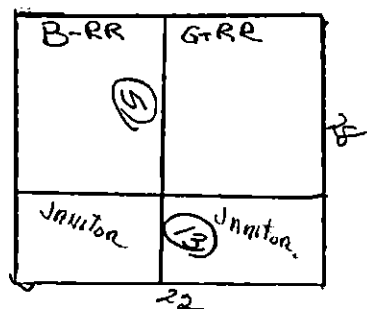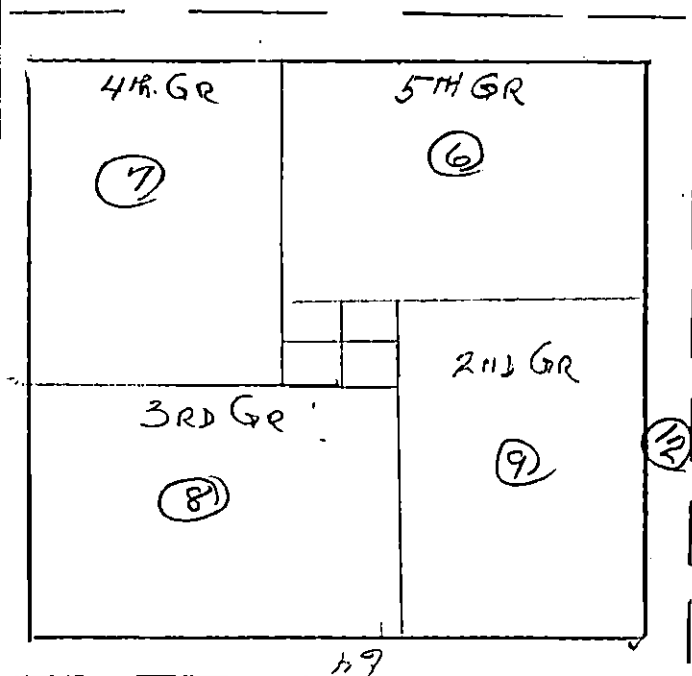

FRESNO - S.D.A. ELEMENTARY SCHOOL
No. 10. IN CODE. - 8964 sq ft.

ACBM

Building: Therm Academy
Functional Area No. 9-59-F-T Location: Pipe Insulation - Furnace Room
Type of Suspect Material: Surfacing, ☒ TSI, Other
Description: Pipe Insulation by Furnace - on Copper pipe
Approximate Amount of Material (linear or square ft.): 4 ft

Condition

Percent Damage: 1 %, Localized, ☒ Distributed
Type of Damage: Deterioration, Water, ☒ Physical
Description: _____

Overall Rating: ☒ Good, Fair, Poor

Potential for Disturbance

Accessibility: Accessible, ☒ Inaccessible
Description: Only to authorized personnel

Potential for Contact: High, Moderate, ☒ Low
Description: _____

Influence of Vibration: High, Moderate, ☒ Low
Description: _____

Potential for Air Erosion: High, Moderate, ☒ Low
Description: _____

Located in a Plenum? Yes, ☒ No; Type: _____

Comments: _____

Signed: GE Date: 10-20-88

CERTIFICATE OF ANALYSIS

LAB I.D.: P-72887
 SAMPLE LOCATION: Fresno 9-59-P-T
 COLLECTED BY: Client
 DATE COLLECTED: Not Given

DATE RECEIVED: November 2, 1988
 DATE STARTED: November 8, 1988
 DATE COMPLETED: November 8, 1988
 DATE REPORTED: November 11, 1988

CLIENT: Herbert Eslinger
 STREET: 9545 W. Hwy 152
 CITY: Dos Palos
 STATE: CA

ZIP: 93620

PURCHASE ORDER: N/A
 OFW #: L8383
 COPY TO: No cc Req.

PLM ANALYSIS

Analyte	Results Volume %	Detect Limit Volume %
ASBESTOS		
CHRYSTILE	5-7 %	
AMOSITE	ND	1.
CROCIDOLITE	ND	1.
ANTHOPHYLITE	ND	1.
TREMOLITE-ACTONOLITE	ND	1.
FIBER GLASS	ND	1.
MINERAL WOOL	ND	1.
CELLULOSE	ND	1.
NON FIBROUS MATERIALS	93-95 %	

APPROVED:

Scott Foster

ACBM

Building: Jrums AcademyFunctional Area No. 9-59-T Location: Furnace RoomType of Suspect Material: Surfacing, ☒ TSI, OtherDescription: Tape around duct work by furnace over blower housingApproximate Amount of Material (linear or square ft.): 3 lin ftConditionPercent Damage: 5 %, ☒ Localized, DistributedType of Damage: ☒ Deterioration, Water, PhysicalDescription: Overall Rating: Good, ☒ Fair, PoorPotential for DisturbanceAccessibility: ☒ Accessible, InaccessibleDescription: Potential for Contact: High, ☒ Moderate, LowDescription: only access by custodial + authorized personnelInfluence of Vibration: High, Moderate, ☒ LowDescription: Potential for Air Erosion: High, ☒ Moderate, LowDescription: air movement inside ductsLocated in a Plenum? Yes, ☒ No; Type: Comments: Signed: gf Date: 10-20-88

CERTIFICATE OF ANALYSIS

LAB I.D.: P-72888
 SAMPLE LOCATION: Fresno 9-59-T
 COLLECTED BY: Client
 DATE COLLECTED: Not Given

DATE RECEIVED: November 2, 1988
 DATE STARTED: November 8, 1988
 DATE COMPLETED: November 8, 1988
 DATE REPORTED: November 11, 1988

CLIENT: Herbert Eslinger
 STREET: 9545 W. Hwy 152
 CITY: Dos Palos
 STATE: CA

ZIP: 93628

PURCHASE ORDER: N/A
 OFW #: L8383
 COPY TO: No cc Req.

PLM ANALYSIS

Analyte	Results Volume %	Detect Limit Volume %
ASBESTOS		
CHRYSDOTILE	75-80 %	
AMOSITE	ND	1.
CROCIDOLITE	ND	1.
ANTHOPHYLITE	ND	1.
TREMOLITE-ACTONOLITE	ND	1.
FIBER GLASS	ND	1.
MINERAL WOOL	ND	1.
CELLULOSE	ND	1.
NON FIBROUS MATERIALS	20-25 %	

APPROVED: Scott Foster

EXHIBIT 13-10 RECORDING FORM FOR ASSESSMENT DATA

Building: Turns Academy ALBM
Functional Area No. 9-59-G Location: Furnace Room
Type of Suspect Material: Surfacing, ☒ TSI, Other
Description: Hosket around burner plate

Approximate Amount of Material (linear or square ft.): 4 lin ft.

Condition

Percent Damage: 2 %, ☒ Localized, Distributed
Type of Damage: Deterioration, Water, Physical
Description:

Overall Rating: Good, ☒ Fair, Poor

Potential for Disturbance

Accessibility: Accessible, ☒ Inaccessible
Description: only to maintenance personnel

Potential for Contact: High, Moderate, ☒ Low
Description:

Influence of Vibration: High, ☒ Moderate, Low
Description:

Potential for Air Erosion: High, Moderate, ☒ Low
Description:

Located in a Plenum? Yes, ☒ No; Type:

Comments:

Signed: ge Date: 10-20-88

CERTIFICATE OF ANALYSIS

LAB I.D.: P-72005
SAMPLE LOCATION: Fresno 9-59-6
COLLECTED BY: Client
DATE COLLECTED: Not Given

DATE RECEIVED: November 2, 1988
DATE STARTED: November 8, 1988
DATE COMPLETED: November 8, 1988
DATE REPORTED: November 11, 1988

CLIENT: Herbert Eslinger
STREET: 9345 W. Hwy 152
CITY: Dos Palos
STATE: CA ZIP: 93620

PURCHASE ORDER: N/A
OFW #: L8383
COPY TO: No cc Req.

PLM ANALYSIS

Analyte	Results Volume %	Detect Limit Volume %
ASBESTOS		
CHRYSTOLITE	85-90 %	
AMOSITE	ND	1.
CROCIDOLITE	ND	1.
ANTHOPHYLITE	ND	1.
TREMOLITE-ACTONOLITE	ND	1.
FIBER GLASS	ND	1.
MINERAL WOOL	ND	1.
CELLULOSE	ND	1.
NON FIBROUS MATERIALS	10-15 %	

APPROVED: 

EXHIBIT 13-10 RECORDING FORM FOR ASSESSMENT DATA

Building:

Therm Academy

ACBM

Functional Area No. 959-F1

Location:

Storage room in Furnace Rm

Type of Suspect Material:

Surfacing,

☒ TSI,

Other

Description:

Wrapped around piping going up next to inside slat cover

Approximate Amount of Material (linear or square ft.):

3 linear ftConditionPercent Damage: 10 %,☐ Localized,☒ Distributed

Type of Damage:

☒ Deterioration,

Water,

☒ Physical

Description:

cracked and large white (needs replaced or repaired)

Overall Rating:

☐ Good,☐ Fair,☒ PoorPotential for Disturbance

Accessibility:

☐ Accessible,☒ Inaccessible

Description:

only to authorized personnel

Potential for Contact:

☐ High,☐ Moderate,☒ Low

Description:

Influence of Vibration:

☐ High,☒ Moderate,☐ Low

Description:

Potential for Air Erosion:

☒ High,☐ Moderate,☐ Low

Description:

plaster at a jointLocated in a Plenum?☐ Yes,☒ No;

Type:

Comments:

Signed:

ge

Date:

10-20-88

CERTIFICATE OF ANALYSIS

LAB I.D.: P-72889
 SAMPLE LOCATION: Fresno 9-59-T1
 COLLECTED BY: Client
 DATE COLLECTED: Not Given

DATE RECEIVED: November 2, 1988
 DATE STARTED: November 9, 1988
 DATE COMPLETED: November 9, 1988
 DATE REPORTED: November 11, 1988

CLIENT: Herbert Eslinger
 STREET: 9345 W. Hwy 152
 CITY: Dos Palos
 STATE: CA


ZIP: 93620

PURCHASE ORDER: N/A
 OFW #: L0383
 COPY TO: No cc Req.

PLM ANALYSIS

Analyte	Results Volume %	Detect Limit Volume %
ASBESTOS		
CHRYSTOTILE	65-70 %	
AMOSITE	ND	1.
CROCIDOLITE	ND	1.
ANTHOPHYLITE	ND	1.
TRENOLITE-ACTONOLITE	ND	1.
FIBER GLASS	ND	1.
MINERAL WOOL	ND	1.
CELLULOSE	10-15 %	
NON FIBROUS MATERIALS	15-25 %	

APPROVED:



EX 3IT 13-10 RECORDING FORM FO. ASSESSMENT DATA

Building: Trinity Academy ACBIM
Functional Area No. 9-57-AS Location: Storage rm. behind science
Type of Suspect Material: ☒ Surfacing, ☐ TSI, ☐ Other
Description: asbestos sheets in cabinet in storage
Approximate Amount of Material (linear or square ft.): 96

Condition

Percent Damage: 0 %, ☐ Localized, ☐ Distributed
Type of Damage: ☐ Deterioration, ☐ Water, ☐ Physical
Description: _____
Overall Rating: ☒ Good, ☐ Fair, ☐ Poor

Potential for Disturbance

Accessibility: ☒ Accessible, ☐ Inaccessible
Description: _____
Potential for Contact: ☒ High, ☐ Moderate, ☐ Low
Description: _____
Influence of Vibration: ☐ High, ☒ Moderate, ☐ Low
Description: _____
Potential for Air Erosion: ☐ High, ☐ Moderate, ☒ Low
Description: _____

Located in a Plenum? ☐ Yes, ☒ No; Type: _____

Comments: _____

Signed: ge Date: 10-20-88

CERTIFICATE OF ANALYSIS

LAB I.D.: P-72005
 SAMPLE LOCATION: Fresno 9-57-AS
 COLLECTED BY: Client
 DATE COLLECTED: Not Given

DATE RECEIVED: November 2, 1988
 DATE STARTED: November 7, 1988
 DATE COMPLETED: November 7, 1988
 DATE REPORTED: November 11, 1988

CLIENT: Herbert Eslinger
 STREET: 9545 W. Hwy 152
 CITY: Dos Palos
 STATE: CA ZIP: 93620

PURCHASE ORDER: N/A
 OFW #: L0383
 COPY TO: No cc Req.

PLM ANALYSIS

Analyte	Results Volume %	Detect Limit Volume %
ASBESTOS		
CHRYSDTILE	40-45 %	
AMOSITE	ND	1.
CROCIDOLITE	ND	1.
ANTHOPHYLITE	ND	1.
TRENOLITE-ACTONOLITE	ND	1.
FIBER GLASS	ND	1.
MINERAL WOOL	ND	1.
CELLULOSE	ND	1.
NON FIBROUS MATERIALS	55-60 %	1.

APPROVED:

Scott Foster

Building: Trinity Academy ACBM
Functional Area No. 9-B3-P1 Location: Bldg 3 under concrete slab.Type of Suspect Material: Surfacing, ☒ TSI, OtherDescription: pipe insulationApproximate Amount of Material (linear or square ft.): 15 linearConditionPercent Damage: 0 %, Localized, DistributedType of Damage: Deterioration, Water, Physical

Description: _____

Overall Rating: ☒ Good, Fair, PoorPotential for DisturbanceAccessibility: Accessible, ☒ Inaccessible

Description: _____

Potential for Contact: High, Moderate, ☒ Low

Description: _____

Influence of Vibration: High, Moderate, ☒ Low

Description: _____

Potential for Air Erosion: High, Moderate, ☒ Low

Description: _____

Located in a Plenum? Yes, ☒ No; Type: _____

Comments: _____

Signed: ge Date: 10-20-88

CERTIFICATE OF ANALYSIS

LAB I.D.: P-71988
 SAMPLE LOCATION: Fresno 9-83-PI
 COLLECTED BY: Client
 DATE COLLECTED: Not Given

DATE RECEIVED: November 2, 1988
 DATE STARTED: November 3, 1988
 DATE COMPLETED: November 3, 1988
 DATE REPORTED: November 11, 1988

CLIENT: Herbert Eslinger
 STREET: 9545 W. Hwy 152
 CITY: Dos Palos
 STATE: CA

ZIP: 93620

PURCHASE ORDER: N/A
 OFW #: L0383
 COPY TO: No cc Req.

PLM ANALYSIS

Analyte	Results Volume %	Detect Limit Volume %
ASBESTOS		
CHRYSTOTILE	20-25 %	
AMOSITE	ND	1.
CROCIDOLITE	5-10 %	
ANTHOPHYLITE	ND	1.
TREMOLITE-ACTONOLITE	ND	1.
FIBER GLASS	ND	1.
MINERAL WOOL	ND	1.
CELLULOSE	ND	1.
NON FIBROUS MATERIALS	65-75 %	

APPROVED: Scott Foster

EBIT 13-10 RECORDING FORM FOR ASSESSMENT DATA

Building: Trinity Academy
 Functional Area No. 9-460-P1 Location: #460 hot water heater room (Boys RR)

Type of Suspect Material: Surfacing, ☒ TSI, Other

Description: pipe insulation

Approximate Amount of Material (linear or square ft.): 10 lin

Condition

Percent Damage: 5 %, ☒ Localized, Distributed

Type of Damage: Deterioration, Water, Physical

Description: _____

Overall Rating: ☒ Good, Fair, Poor

Potential for Disturbance

Accessibility: Accessible, ☒ Inaccessible

Description: _____

Potential for Contact: High, Moderate, ☒ Low

Description: _____

Influence of Vibration: High, Moderate, ☒ Low

Description: _____

Potential for Air Erosion: High, Moderate, ☒ Low

Description: _____

Located in a Plenum? Yes, ☒ No; Type: _____

Comments: _____

Signed: ge

Date: 10-20-88

CERTIFICATE OF ANALYSIS

LAB I.D.: P-72882
 SAMPLE LOCATION: Fresno 9-46a-P1
 COLLECTED BY: Client
 DATE COLLECTED: Not Given

DATE RECEIVED: November 2, 1988
 DATE STARTED: November 7, 1988
 DATE COMPLETED: November 7, 1988
 DATE REPORTED: November 11, 1988

CLIENT: Herbert Eslinger
 STREET: 9545 W. Hwy 152
 CITY: Dos Palos
 STATE: CA ZIP: 93620

PURCHASE ORDER: N/A
 OFW #: L0383
 COPY TO: No cc Req.

PLM ANALYSIS

Analyte	Results Volume %	Detect Limit Volume %
ASBESTOS		
CHRYSDTILE	ND	1.
AMOSITE	ND	1.
CROCIDOLITE	ND	1.
ANTHOPHYLITE	ND	1.
TREMOLITE-ACTONOLITE	ND	1.
FIBER GLASS	ND	1.
MINERAL WOOL	ND	1.
CELLULOSE	ND	1.
NON FIBROUS MATERIALS	100. %	

APPROVED: Scott Foster

ACBM

Building: Ipswich Academy (Mansion) (art + music building)Functional Area No. 9-11a-1 Location: hall in kitchen in mansionType of Suspect Material: Surfacing, TSI, ✓ OtherDescription: vinyl floor coveringalso found in Room - 20a, 16Approximate Amount of Material (linear or square ft.): <200ConditionPercent Damage: 1 %, Localized, ✓ DistributedType of Damage: Deterioration, Water, PhysicalDescription: Overall Rating: ✓ Good, Fair, PoorPotential for DisturbanceAccessibility: Accessible, InaccessibleDescription: Potential for Contact: ✓ High, Moderate, LowDescription: Influence of Vibration: High, Moderate, ✓ LowDescription: Potential for Air Erosion: High, Moderate, ✓ LowDescription: Located in a Plenum? Yes, ✓ No;Type: Comments: Signed: Date: 10-20-88

CERTIFICATE OF ANALYSIS

LAB I.D.: P-71996
 SAMPLE LOCATION: Fresno 9-16a-V
 COLLECTED BY: Client
 DATE COLLECTED: Not Given

DATE RECEIVED: November 2, 1988
 DATE STARTED: November 3, 1988
 DATE COMPLETED: November 3, 1988
 DATE REPORTED: November 11, 1988

CLIENT: Herbert Eslinger
 STREET: 9545 W. Hwy 152
 CITY: Dos Palos
 STATE: CA

ZIP: 93620

PURCHASE ORDER: N/A
 OFW #: L9383
 COPY TO: No cc Req.

PLM ANALYSIS

Analyte	Results Volume %	Detect Limit Volume %
ASBESTOS		
CHRYSDOTILE	3-5 %	
AMOSITE	ND	1.
CROCIDOLITE	ND	1.
ANTHOPHYLITE	ND	1.
TRENDLITE-ACTONOLITE	ND	1.
FIBER GLASS	ND	1.
MINERAL WOOL	ND	1.
CELLULOSE	18-15 %	
NON FIBROUS MATERIALS	88-87 %	

APPROVED: Scott Foster

EX. BIT 13-10 RECORDING FORM FOR ASSESSMENT DATA

Building: Spinn Academy

Functional Area No. 9-17-F Location: painting room # 17

Type of Suspect Material: ☒ Surfacing, ☐ TSI, ☐ Other

Description: wall paper over fractured wall
(through masonry)

Approximate Amount of Material (linear or square ft.): 1200

Condition

Percent Damage: 0 %, ☐ Localized, ☐ Distributed

Type of Damage: ☐ Deterioration, ☐ Water, ☐ Physical

Description: _____

Overall Rating: ☒ Good, ☐ Fair, ☐ Poor

Potential for Disturbance

Accessibility: ☐ Accessible, ☐ Inaccessible

Description: _____

Potential for Contact: ☐ High, ☐ Moderate, ☒ Low

Description: _____

Influence of Vibration: ☐ High, ☐ Moderate, ☒ Low

Description: _____

Potential for Air Erosion: ☐ High, ☐ Moderate, ☒ Low

Description: _____

Located in a Plenum? ☐ Yes, ☒ No; Type: _____

Comments: _____

Signed: ge Date: 10-20-88

CERTIFICATE OF ANALYSIS

LAB I.D.: P-71997
 SAMPLE LOCATION: Fresno 9-17-P
 COLLECTED BY: Client
 DATE COLLECTED: Not Given

DATE RECEIVED: November 2, 1988
 DATE STARTED: November 3, 1988
 DATE COMPLETED: November 3, 1988
 DATE REPORTED: November 11, 1988

CLIENT: Herbert Eslinger
 STREET: 9545 W. Hwy 152
 CITY: Dos Palos
 STATE: CA ZIP: 93628

PURCHASE ORDER: N/A
 OFW #: L0303
 COPY TO: No cc Req.

PLM - ANALYSIS

Analyte	Results Volume %	Detect Limit Volume %
ASBESTOS		
CHRYSTOLITE	ND	1.
AMOSITE	ND	1.
CROCIDOLITE	ND	1.
ANTHOPHYLITE	ND	1.
TREMOLITE-ACTONOLITE	ND	1.
FIBER GLASS	ND	1.
MINERAL WOOL	ND	1.
CELLULOSE	30-35 %	
NON FIBROUS MATERIALS	65-70 %	

APPROVED: Scott Frost

EXHIBIT 13-10 RECORDING FORM FOR ASSESSMENT DATA

Building: Spinn Academy

Functional Area No. 9att-I Location: attic in Mantion

Type of Suspect Material: Surfacing, ☒ TSI, Other

Description: insulation

Approximate Amount of Material (linear or square ft.): 2000

Condition

Percent Damage: %, Localized, Distributed

Type of Damage: Deterioration, Water, Physical

Description:

Overall Rating: ☒ Good, Fair, Poor

Potential for Disturbance

Accessibility: Accessible, Inaccessible

Description:

Potential for Contact: High, Moderate, ☒ Low

Description:

Influence of Vibration: High, Moderate, ☒ Low

Description:

Potential for Air Erosion: High, ☒ Moderate, Low

Description:

Located in a Plenum? Yes, ☒ No; Type:

Comments:

Signed: ge Date: 10-20-88

CERTIFICATE OF ANALYSIS

LAB I.D.: P-71987
SAMPLE LOCATION: Fresno 9-ATT-I
COLLECTED BY: Client
DATE COLLECTED: Not Given

DATE RECEIVED: November 2, 1988
DATE STARTED: November 3, 1988
DATE COMPLETED: November 3, 1988
DATE REPORTED: November 11, 1988

CLIENT: Herbert Eslinger
STREET: 9545 W. Hwy 152
CITY: Dos Palos
STATE: CA

ZIP: 93620

PURCHASE ORDER: N/A
OFW #: L8383
COPY TO: No cc Req.

PLM ANALYSIS

Analyte	Results Volume %	Detect Limit Volume %
ASBESTOS		
CHRYSDTILE	ND	1.
AMOSITE	ND	1.
CROCIDOLITE	ND	1.
ANTHOPHYLITE	ND	1.
TREMOLITE-ACTONOLITE	ND	1.
FIBER GLASS	90-95 %	
MINERAL WOOL	ND	1.
CELLULOSE	5-10 %	
NON FIBROUS MATERIALS	ND	1.

APPROVED: Scott Foster

EX .BIT 13-10 RECORDING FORM FOR ASSESSMENT DATA

Building: Trums Academy

Functional Area No. 9-36-VP Location: Office

Type of Suspect Material: ☒ Surfacing, ☐ TSI, ☐ Other

Description: wrapping paper

Approximate Amount of Material (linear or square ft.): 120

Condition

Percent Damage: 0 %, ☐ Localized, ☐ Distributed

Type of Damage: ☐ Deterioration, ☐ Water, ☐ Physical

Description: _____

Overall Rating: ☒ Good, ☐ Fair, ☐ Poor

Potential for Disturbance

Accessibility: ☐ Accessible, ☒ Inaccessible

Description: _____

Potential for Contact: ☐ High, ☐ Moderate, ☒ Low

Description: _____

Influence of Vibration: ☐ High, ☐ Moderate, ☒ Low

Description: _____

Potential for Air Erosion: ☐ High, ☐ Moderate, ☒ Low

Description: _____

Located in a Plenum? ☐ Yes, ☒ No; Type: _____

Comments: _____

Signed: GP Date: 10-20-88

CERTIFICATE OF ANALYSIS

LAB I.D.: P-71999
 SAMPLE LOCATION: Fresno 9-36-VP
 COLLECTED BY: Client
 DATE COLLECTED: Not Given

DATE RECEIVED: November 2, 1988
 DATE STARTED: November 3, 1988
 DATE COMPLETED: November 3, 1988
 DATE REPORTED: November 11, 1988

CLIENT: Herbert Eslinger
 STREET: 9545 W. Hwy 152
 CITY: Dos Palos
 STATE: CA ZIP: 93620

PURCHASE ORDER: N/A
 OFW #: L8383
 COPY TO: No cc Req.

PLM ANALYSIS

Analyte	Results Volume 1	Detect Limit Volume 1
ASBESTOS		
CHRYSTOLITE	ND	1.
AMOSITE	ND	1.
CROCIDOLITE	ND	1.
ANTHOPHYLITE	ND	1.
TREMOLITE-ACTONOLITE	ND	1.
FIBER GLASS	ND	1.
MINERAL WOOL	ND	1.
CELLULOSE	48-45 %	
NON FIBROUS MATERIALS	55-60 %	

APPROVED: 

Building: Truman Academy
Functional Area No. 9-8-SRT Location: Miller Hall - Pathfinder
Type of Suspect Material: ☒ Surfacing, ☐ TSI, ☐ Other
Description: Sheet rock tape on ceiling

Approximate Amount of Material (linear or square ft.): 288

Condition

Percent Damage: 1 %, ☒ Localized, ☐ Distributed
Type of Damage: ☒ Deterioration, ☐ Water, ☐ Physical
Description: _____

Overall Rating: ☒ Good, ☐ Fair, ☐ Poor

Potential for Disturbance

Accessibility: ☐ Accessible, ☒ Inaccessible

Description: _____

Potential for Contact: ☐ High, ☐ Moderate, ☒ Low

Description: _____

Influence of Vibration: ☐ High, ☐ Moderate, ☒ Low

Description: _____

Potential for Air Erosion: ☐ High, ☐ Moderate, ☒ Low

Description: _____

Located in a Plenum? ☐ Yes, ☒ No; Type: _____

Comments: _____

Signed: ge Date: 10-25-88

CERTIFICATE OF ANALYSIS

LAB I.D.: P-71992
 SAMPLE LOCATION: Fresno 9-8-SR-T
 COLLECTED BY: Client
 DATE COLLECTED: Not Given

DATE RECEIVED: November 2, 1988
 DATE STARTED: November 3, 1988
 DATE COMPLETED: November 3, 1988
 DATE REPORTED: November 11, 1988

CLIENT: Herbert Eslinger
 STREET: 9545 W. Hwy 152
 CITY: Dos Palos
 STATE: CA

ZIP: 93620

PURCHASE ORDER: N/A
 OFW #: L8383
 COPY TO: No cc Req.

PLM ANALYSIS

Analyte	Results Volume %	Detect Limit Volume %
ASBESTOS		
CHRYSTILE	ND	1.
AMOSITE	ND	1.
CROCIDOLITE	ND	1.
ANTHOPHYLITE	ND	1.
TRENOLITE-ACTONOLITE	ND	1.
FIBER GLASS	ND	1.
MINERAL WOOL	ND	1.
CELLULOSE	85-90 %	
NON FIBROUS MATERIALS	10-15 %	

APPROVED: 

EXHIBIT 13-10 RECORDING FORM FOR ASSESSMENT DATA

Building: Music - Center

Functional Area No. 9-14-V Location: Lobby (14, 12)

Type of Suspect Material: Surfacing, TSI, ☒ Other

Description: Latent Vandal in Lobby and Storage
likely under cabinet in R/R

Approximate Amount of Material (linear or square ft.): 480

Condition

Percent Damage: %, Localized, Distributed

Type of Damage: Deterioration, Water, Physical

Description:

Overall Rating: ☒ Good, Fair, Poor

Potential for Disturbance

Accessibility: Accessible, Inaccessible

Description:

Potential for Contact: High, ☒ Moderate, Low

Description:

Influence of Vibration: High, Moderate, ☒ Low

Description:

Potential for Air Erosion: High, Moderate, ☒ Low

Description:

Located in a Plenum? Yes, ☒ No; Type:

Comments:

Signed:  Date: 10-20-88

CERTIFICATE OF ANALYSIS

LAB I.D.: P-71995
 SAMPLE LOCATION: Fresno 9-14-V
 COLLECTED BY: Client
 DATE COLLECTED: Not Given

DATE RECEIVED: November 2, 1988
 DATE STARTED: November 3, 1988
 DATE COMPLETED: November 3, 1988
 DATE REPORTED: November 11, 1988

CLIENT: Herbert Eslinger
 STREET: 9545 W. Hwy 152
 CITY: Dos Palos
 STATE: CA

ZIP: 93620

PURCHASE ORDER: N/A
 OFW #: L0383
 COPY TO: No cc Req.

PLM ANALYSIS

Analyte	Results Volume Z	Detect Limit Volume Z
ASBESTOS		
CHRYSTOTILE	ND	1.
AMOSITE	ND	1.
CROCIDOLITE	ND	1.
ANTHOPHYLITE	ND	1.
TREMOLITE-ACTONOLITE	ND	1.
FIBER GLASS	ND	1.
MINERAL WOOL	ND	1.
CELLULOSE	35-40 Z	
NON FIBROUS MATERIALS	68-65 Z	

APPROVED: Scott Foster

EX JIT 13-10 RECORDING FORM FO ASSESSMENT DATA

Building: Spring AcademyFunctional Area No. 9-44-VP Location: Home Ec roomType of Suspect Material: ☒ Surfacing, ☐ TSI, ☐ OtherDescription: vinyl paper on wallApproximate Amount of Material (linear or square ft.): 160ConditionPercent Damage: 0 %, ☐ Localized, ☐ DistributedType of Damage: ☐ Deterioration, ☐ Water, ☐ Physical

Description: _____

Overall Rating: ☒ Good, ☐ Fair, ☐ PoorPotential for DisturbanceAccessibility: ☐ Accessible, ☐ Inaccessible

Description: _____

Potential for Contact: ☒ High, ☐ Moderate, ☐ Low

Description: _____

Influence of Vibration: ☐ High, ☐ Moderate, ☒ Low

Description: _____

Potential for Air Erosion: ☐ High, ☐ Moderate, ☒ Low

Description: _____

Located in a Plenum? ☐ Yes, ☒ No; Type: _____

Comments: _____

Signed: ge Date: 10-20-88

CERTIFICATE OF ANALYSIS

LAB I.D.: P-72881
SAMPLE LOCATION: Fresno 9-44-VP
COLLECTED BY: Client
DATE COLLECTED: Not Given

DATE RECEIVED: November 2, 1988
DATE STARTED: November 7, 1988
DATE COMPLETED: November 7, 1988
DATE REPORTED: November 11, 1988

CLIENT: Herbert Eslinger
STREET: 9545 W. Hwy 152
CITY: Dos Palos
STATE: CA ZIP: 93620

PURCHASE ORDER: N/A
OFW #: L8383
COPY TO: No cc Req.

PLM ANALYSIS

Analyte	Results Volume %	Detect Limit Volume %
ASBESTOS		
CHRYSTILE	ND	1.
AMOSITE	ND	1.
CROCIDOLITE	ND	1.
ANTHOPHYLITE	ND	1.
TREMOLITE-ACTONOLITE	ND	1.
FIBER GLASS	ND	1.
MINERAL WOOL	ND	1.
CELLULOSE	20-25 %	
NON FIBROUS MATERIALS	75-80 %	

APPROVED: 

EXHIBIT 13-10 RECORDING FORM FOR ASSESSMENT DATA

Building: Trinity Academy

Functional Area No. 9-44-T Location: Home Economics

Type of Suspect Material: Surfacing, TSI, Other

Description: 2x4 fiber board in ceiling throughout

Approximate Amount of Material (linear or square ft.): 4096

Condition

Percent Damage: 0 %, Localized, Distributed

Type of Damage: Deterioration, Water, Physical

Description: _____

Overall Rating: ✓ Good, Fair, Poor

Potential for Disturbance

Accessibility: Accessible, ✓ Inaccessible

Description: _____

Potential for Contact: High, Moderate, ✓ Low

Description: _____

Influence of Vibration: High, Moderate, ✓ Low

Description: _____

Potential for Air Erosion: High, Moderate, ✓ Low

Description: _____

Located in a Plenum? Yes, ✓ No; Type: _____

Comments: _____

Signed: ge Date: 10-20-88

CERTIFICATE OF ANALYSIS

LAB I.D.: P-72888
 SAMPLE LOCATION: Fresno 9-44-T
 COLLECTED BY: Client
 DATE COLLECTED: Not Given

DATE RECEIVED: November 2, 1988
 DATE STARTED: November 7, 1988
 DATE COMPLETED: November 7, 1988
 DATE REPORTED: November 11, 1988

CLIENT: Herbert Eslinger
 STREET: 9545 W. Hwy 152
 CITY: Dos Palos
 STATE: CA

ZIP: 93620

PURCHASE ORDER: N/A
 OFW #: L8383
 COPY TO: No cc Req.

PLM ANALYSIS

Analyte	Results Volume %	Detect Limit Volume %
ASBESTOS		
CHRYSDTILE	ND	1.
AMOSITE	ND	1.
CROCIDOLITE	ND	1.
ANTHOPHYLITE	ND	1.
TREMOLITE-ACTONOLITE	ND	1.
FIBER GLASS	5-7 %	
MINERAL WOOL	ND	1.
CELLULOSE	70-75 %	
NON FIBROUS MATERIALS	18-25 %	

APPROVED: 

EX. BIT 13-10 RECORDING FORM FO. ASSESSMENT DATA

Building: Trinity Academy
Functional Area No. 9-19-P1 Location: Painting Room #19 (under paper through mantion)
Type of Suspect Material: ☒ Surfacing, ☐ TSI, ☐ Other
Description: plaster behind paper through-out mantion
Approximate Amount of Material (linear or square ft.): 2000

Condition

Percent Damage: 3 %, ☒ Localized, ☐ Distributed
Type of Damage: ☒ Deterioration, ☒ Water, ☐ Physical
Description: _____

Overall Rating: ☐ Good, ☒ Fair, ☐ Poor

Potential for Disturbance

Accessibility: ☒ Accessible, ☐ Inaccessible

Description: _____

Potential for Contact: ☐ High, ☒ Moderate, ☐ Low

Description: _____

Influence of Vibration: ☐ High, ☐ Moderate, ☒ Low

Description: _____

Potential for Air Erosion: ☐ High, ☐ Moderate, ☒ Low

Description: _____

Located in a Plenum? ☐ Yes, ☒ No; Type: _____

Comments: _____

Signed: gr

Date: 10-20-88

CERTIFICATE OF ANALYSIS

LAB I.D.: P-71998
 SAMPLE LOCATION: Fresno 9-19-P1
 COLLECTED BY: Client
 DATE COLLECTED: Not Given

DATE RECEIVED: November 2, 1988
 DATE STARTED: November 3, 1988
 DATE COMPLETED: November 3, 1988
 DATE REPORTED: November 11, 1988

CLIENT: Herbert Eslinger
 STREET: 9545 W. Hwy 152
 CITY: Dos Palos
 STATE: CA

ZIP: 93620

PURCHASE ORDER: N/A
 OFW #: L8383
 COPY TO: No cc Req.

PLM ANALYSIS

Analyte	Results Volume 1	Detect Limit Volume 1
ASBESTOS		
CHRYSDOTILE	ND	1.
AMOSITE	ND	1.
CROCIDOLITE	ND	1.
ANTHOPHYLITE	ND	1.
TREMOLITE-ACTONOLITE	ND	1.
FIBER GLASS	ND	1.
MINERAL WOOL	ND	1.
CELLULOSE	ND	1.
NON FIBROUS MATERIALS	100. %	

APPROVED:

Scott Foster

Building: Ipswich Academy
Functional Area No. 9-52-T Location: English room #52
Type of Suspect Material: ☒ Surfacing, ☐ TSI, ☐ Other
Description: 12x12 cellulose tile 16" down from ceiling (throughout)
Approximate Amount of Material (linear or square ft.): 12,288

Condition

Percent Damage: 0 %, ☐ Localized, ☐ Distributed
Type of Damage: ☐ Deterioration, ☐ Water, ☐ Physical
Description: _____

Overall Rating: ☒ Good, ☐ Fair, ☐ Poor

Potential for Disturbance

Accessibility: ☐ Accessible, ☒ Inaccessible

Description: _____

Potential for Contact: ☐ High, ☐ Moderate, ☒ Low

Description: _____

Influence of Vibration: ☐ High, ☐ Moderate, ☒ Low

Description: _____

Potential for Air Erosion: ☐ High, ☐ Moderate, ☒ Low

Description: _____

Located in a Plenum? ☐ Yes, ☒ No; Type: _____

Comments: _____

Signed: GE Date: 10-20-88

31

CERTIFICATE OF ANALYSIS

LAB I.D.: P-72004
 SAMPLE LOCATION: Fresno 9-52-T
 COLLECTED BY: Client
 DATE COLLECTED: Not Given

DATE RECEIVED: November 2, 1988
 DATE STARTED: November 7, 1988
 DATE COMPLETED: November 7, 1988
 DATE REPORTED: November 11, 1988

CLIENT: Herbert Eslinger
 STREET: 9545 W. Hwy 152
 CITY: Dos Palos
 STATE: CA ZIP: 93620

PURCHASE ORDER: N/A
 OFW #: L0383
 COPY TO: No cc Req.

PLM ANALYSIS

Analyte	Results Volume 1	Detect Limit Volume 1
ASBESTOS		
CHRYSTOTILE	ND	1.
AMOSITE	ND	1.
CROCIDOLITE	ND	1.
ANTHOPHYLITE	ND	1.
TRENOLITE-ACTONOLITE	ND	1.
FIBER GLASS	ND	1.
MINERAL WOOL	ND	1.
CELLULOSE	100. %	
NON-FIBROUS MATERIALS	ND	1.

APPROVED:

Leath Foster

EX. 31T 13-10 RECORDING FORM FOR ASSESSMENT DATA

Building: Trinity AcademyFunctional Area No. 9-52-BB Location: rm 52 English roomType of Suspect Material: ☒ Surfacing, ☐ TSI, ☐ OtherDescription: base boardApproximate Amount of Material (linear or square ft.): 1000ConditionPercent Damage: 0 %, ☐ Localized, ☐ DistributedType of Damage: ☐ Deterioration, ☐ Water, ☐ Physical

Description: _____

Overall Rating: ☒ Good, ☐ Fair, ☐ PoorPotential for DisturbanceAccessibility: ☒ Accessible, ☐ Inaccessible

Description: _____

Potential for Contact: ☐ High, ☒ Moderate, ☐ Low

Description: _____

Influence of Vibration: ☐ High, ☐ Moderate, ☒ Low

Description: _____

Potential for Air Erosion: ☐ High, ☐ Moderate, ☒ Low

Description: _____

Located in a Plenum? ☐ Yes, ☒ No; Type: _____

Comments: _____

Signed: ge Date: 10-20-88

CERTIFICATE OF ANALYSIS

LAB I.D.: P-72883
 SAMPLE LOCATION: Fresno 9-52-88
 COLLECTED BY: Client
 DATE COLLECTED: Not Given

DATE RECEIVED: November 2, 1988
 DATE STARTED: November 7, 1988
 DATE COMPLETED: November 7, 1988
 DATE REPORTED: November 11, 1988

CLIENT: Herbert Eslinger
 STREET: 9545 W. Hwy 152
 CITY: Dos Palos
 STATE: CA

ZIP: 93620

PURCHASE ORDER: N/A
 QFW #: L0383
 COPY TO: No cc Req.

PLM ANALYSIS

Analyte	Results Volume 1	Detect Limit Volume 1
ASBESTOS		
CHRYSDOTILE	ND	1.
AMOSITE	ND	1.
CROCIDOLITE	ND	1.
ANTHOPHYLITE	ND	1.
TRENOLITE-ACTONOLITE	ND	1.
FIBER GLASS	ND	1.
MINERAL WOOL	ND	1.
CELLULOSE	ND	1.
NON FIBROUS MATERIALS	100.1	

APPROVED: Scott Foster

Building: Industrial Arts - Fresno Academy
Functional Area No. 9-1-CT Location: Ind. Arts ceiling tiles
Type of Suspect Material: Surfacing, TSI, ☒ Other
Description: cellulose - 2x4 ceiling tile

Approximate Amount of Material (linear or square ft.): 4756

Condition

Percent Damage: 5 %, Localized, ☒ Distributed
Type of Damage: Deterioration, Water, ☒ Physical
Description: few holes made by sticks

Overall Rating: ☒ Good, Fair, Poor

Potential for Disturbance

Accessibility: ☒ Accessible, Inaccessible
Description: within reach with sticks

Potential for Contact: High, Moderate, ☒ Low
Description:

Influence of Vibration: High, Moderate, ☒ Low
Description:

Potential for Air Erosion: High, Moderate, ☒ Low
Description:

Located in a Plenum? Yes, ☒ No; Type:

Comments:

Signed: gf Date: 10-20-88

CERTIFICATE OF ANALYSIS

LAB I.D.: P-71989
 SAMPLE LOCATION: Fresno 9-1-CT
 COLLECTED BY: Client
 DATE COLLECTED: Not Given

DATE RECEIVED: November 2, 1988
 DATE STARTED: November 3, 1988
 DATE COMPLETED: November 3, 1988
 DATE REPORTED: November 11, 1988

CLIENT: Herbert Eslinger
 STREET: 9545 W. Hwy 152
 CITY: Dos Palos
 STATE: CA

ZIP: 93620

PURCHASE ORDER: N/A
 OFW #: L0383
 COPY TO: No cc Req.

PLM ANALYSIS

<u>Analyte</u>	<u>Results Volume %</u>	<u>Detect Limit Volume %</u>
ASBESTOS		
CHRYSTILE	ND	1.
AMOSITE	ND	1.
CROCIDOLITE	ND	1.
ANTHOPHYLITE	ND	1.
TRENOLITE-ACTONOLITE	ND	1.
FIBER GLASS	50-55 %	
MINERAL WOOL	ND	1.
CELLULOSE	42-48 %	
NON FIBROUS MATERIALS	2-3 %	

APPROVED: Deatt Foster

EXHIBIT 13-10 RECORDING FORM FOR ASSESSMENT DATA

Building: Friends Academy
Functional Area No. 9-3-SA Location: Classroom - Office in Ind. Bldg.

Type of Suspect Material: ☒ Surfacing, ☐ TSI, ☐ Other

Description: sprayed acoustical ceiling

Approximate Amount of Material (linear or square ft.): 150

Condition

Percent Damage: 0 %, ☐ Localized, ☐ Distributed

Type of Damage: ☐ Deterioration, ☐ Water, ☐ Physical

Description: _____

Overall Rating: ☒ Good, ☐ Fair, ☐ Poor

Potential for Disturbance

Accessibility: ☒ Accessible, ☐ Inaccessible

Description: 8 feet up - mainly out of reach

Potential for Contact: ☐ High, ☐ Moderate, ☒ Low

Description: _____

Influence of Vibration: ☐ High, ☐ Moderate, ☒ Low

Description: _____

Potential for Air Erosion: ☐ High, ☐ Moderate, ☒ Low

Description: _____

Located in a Plenum? ☐ Yes, ☒ No; Type: _____

Comments: _____

Signed: ge Date: 10-20-88

CERTIFICATE OF ANALYSIS

LAB I.D.: P-71990
 SAMPLE LOCATION: Fresno 9-3-SA
 COLLECTED BY: Client
 DATE COLLECTED: Not Given

DATE RECEIVED: November 2, 1988
 DATE STARTED: November 3, 1988
 DATE COMPLETED: November 3, 1988
 DATE REPORTED: November 11, 1988

CLIENT: Herbert Eslinger
 STREET: 9545 W. Hwy 152
 CITY: Dos Palos
 STATE: CA

ZIP: 93620

PURCHASE ORDER: N/A
 OFW #: LB383
 COPY TO: No cc Req.

PLM ANALYSIS

Analyte	Results Volume %	Detect Limit Volume %
ASBESTOS		
CHRYSTOTILE	ND	1.
AMOSITE	ND	1.
CROCIDOLITE	ND	1.
ANTHOPHYLITE	ND	1.
TRENOLITE-ACTONOLITE	ND	1.
FIBER GLASS	ND	1.
MINERAL WOOL	ND	1.
CELLULOSE	ND	1.
NON FIBROUS MATERIALS	100. %	

APPROVED: Scott Trickett

EXHIBIT 13-10 RECORDING FORM FOR ASSESSMENT DATA

Building: James Academy

Functional Area No. 9-11-V-B Location: Office of Basic Maintenance

Type of Suspect Material: Surfacing, TSI, Other

Description: Vinyl Covered (Dumppack) fiber material over tag board

Approximate Amount of Material (linear or square ft.): 32

Condition

Percent Damage: %, Localized, ✓ Distributed

Type of Damage: Deterioration, Water, ✓ Physical

Description: pin holes through-out

Overall Rating: Good, ✓ Fair, Poor

Potential for Disturbance

Accessibility: ✓ Accessible, Inaccessible

Description: always used

Potential for Contact: ✓ High, Moderate, Low

Description:

Influence of Vibration: ✓ High, Moderate, Low

Description:

Potential for Air Erosion: High, ✓ Moderate, Low

Description:

Located in a Plenum? Yes, ✓ No; Type:

Comments:

Signed: de Date: 10-20-88

CERTIFICATE OF ANALYSIS

LAB I.D.: P-71994
 SAMPLE LOCATION: Fresno 9-11-V-B
 COLLECTED BY: Client
 DATE COLLECTED: Not Given

DATE RECEIVED: November 2, 1988
 DATE STARTED: November 3, 1988
 DATE COMPLETED: November 3, 1988
 DATE REPORTED: November 11, 1988

CLIENT: Herbert Eslinger
 STREET: 9545 W. Hwy 152
 CITY: Dos Palos
 STATE: CA ZIP: 93620

PURCHASE ORDER: N/A
 QFN #: L8383
 COPY TO: No cc Req.

PLM ANALYSIS

Analyte	Results Volume %	Detect Limit Volume %
ASBESTOS		
CHRYSDTILE	ND	1.
AMOSITE	ND	1.
CROCIDDLITE	ND	1.
ANTHOPHYLITE	ND	1.
TRENOLITE-ACTONOLITE	ND	1.
FIBER GLASS	ND	1.
MINERAL WOOL	ND	1.
CELLULOSE	65-78 %	
NON FIBROUS MATERIALS	30-35 %	

APPROVED: Scott Foster

Building: Green Academy
Functional Area No. 9-9-I Location: restroom in Bus Maintenance Rm.
Type of Suspect Material: Surfacing, TSI, ☒ Other
Description: insulation in attic

Approximate Amount of Material (linear or square ft.): 4750

Condition

Percent Damage: 0 %, Localized, Distributed
Type of Damage: Deterioration, Water, Physical
Description: _____

Overall Rating: Good, Fair, Poor

Potential for Disturbance

Accessibility: Accessible, ☒ Inaccessible

Description: in the attic

Potential for Contact: High, Moderate, ☒ Low
Description: _____

Influence of Vibration: High, Moderate, ☒ Low
Description: _____

Potential for Air Erosion: High, Moderate, ☒ Low
Description: _____

Located in a Plenum? Yes, No; Type: _____

Comments: _____

Signed: GLE Date: 10-20-88

CERTIFICATE OF ANALYSIS

LAB I.D.: P-71993
 SAMPLE LOCATION: Fresno 9-9-I
 COLLECTED BY: Client
 DATE COLLECTED: Not Given

DATE RECEIVED: November 2, 1988
 DATE STARTED: November 3, 1988
 DATE COMPLETED: November 3, 1988
 DATE REPORTED: November 11, 1988

CLIENT: Herbert Eslinger
 STREET: 9545 W. Hwy 152
 CITY: Dos Palos
 STATE: CA

ZIP: 93620

PURCHASE ORDER: N/A
 OFW #: L0383
 COPY TO: No cc Req.

PLM ANALYSIS

Analyte	Results Volume %	Detect Limit Volume %
ASBESTOS		
CHRYSTILE	ND	1.
AMOSITE	ND	1.
CROCIDOLITE	ND	1.
ANTHOPHYLITE	ND	1.
TREMOLITE-ACTONOLITE	ND	1.
FIBER GLASS	93-96 %	
MINERAL WOOL	ND	1.
CELLULOSE	3-5 %	
NON FIBROUS MATERIALS	1-2 %	

APPROVED: Scott Foster

Building: Therms Academy
 Functional Area No. 9-8-I Location: Miller Hall - pathfinder
 Type of Suspect Material: Surfacing, TSI, ☒ Other
 Description: insulation in attic

Approximate Amount of Material (linear or square ft.): 1872

Condition

Percent Damage: 0 %, Localized, Distributed
 Type of Damage: Deterioration, Water, Physical
 Description: _____

Overall Rating: Good, ☒ Fair, Poor

Potential for Disturbance

Accessibility: Accessible, ☒ Inaccessible

Description: blow in the attic

Potential for Contact: High, Moderate, ☒ Low

Description: except when going in attic

Influence of Vibration: High, ☒ Moderate, Low

Description: _____

Potential for Air Erosion: ☒ High, Moderate, Low

Description: easily blown

Located in a Plenum? Yes, ☒ No; Type: _____

Comments: _____

Signed: ge Date: 10-20-88

CERTIFICATE OF ANALYSIS

LAB I.D.: P-71991
 SAMPLE LOCATION: Fresno 9-8-1
 COLLECTED BY: Client
 DATE COLLECTED: Not Given

DATE RECEIVED: November 2, 1988
 DATE STARTED: November 3, 1988
 DATE COMPLETED: November 3, 1988
 DATE REPORTED: November 11, 1988

CLIENT: Herbert Eslinger
 STREET: 9545 W. Hwy 152
 CITY: Dos Palos
 STATE: CA ZIP: 93620

PURCHASE ORDER: N/A
 OFW #: L0383
 COPY TO: No cc Req.

PLM ANALYSIS

Analyte	Results Volume %	Detect Limit Volume %
ASBESTOS		
CHRYSDTILE	ND	1.
AMOSITE	ND	1.
CROCIDOLITE	ND	1.
ANTHOPHYLITE	ND	1.
TRENOLITE-ACTONOLITE	ND	1.
FIBER GLASS	100. %	
MINERAL WOOL	ND	1.
CELLULOSE	ND	1.
NON FIBROUS MATERIALS	ND	1.

APPROVED: Scott Foster

PHYSICAL AND HAZARD ASSESSMENT OF FRIABLE
ACBM OR FRIABLE ASSUMED ACBM (Form C)
(SEC. 763.93)

				CDS CODE 10-62166-6933691	
SCHOOL Fresno SDA Academy				School Phone # (209)251-5548	
ADDRESS		(NUMBER) 5397 E. Olive Ave.	(CITY) Fresno	(ZIP CODE) 93727	
BUILDING NAME 59-Furnace Rm. in Arts and Music Bldg.				INSPECTION DATE 10-20-88	
FUNCTIONAL SPACE 9-59-T (furnace rm.)			INDICATE LINE # FROM FORM B 1		
TYPE OF FRIABLE ACBM	SURFACING	X	TSI	MISCELLANEOUS	
1. CONDITION OF ACBM (OVERALL RATING)					
<input type="checkbox"/> GOOD <input checked="" type="checkbox"/> DAMAGED <input type="checkbox"/> SIGNIFICANTLY DAMAGED					
2. POTENTIAL FOR DISTURBANCE (Overall Rating)					
<input checked="" type="checkbox"/> LOW <input type="checkbox"/> MODERATE <input type="checkbox"/> HIGH					
3. HAZARD ASSESSMENT (Combine ratings from items 1 and 2 and check appropriate box)					
CONDITION OF ACBM			Potential for Disturbance		
			LOW	MODERATE	HIGH
GOOD			X		
DAMAGED					
SIGNIFICANTLY DAMAGED					
4. RECOMMENDED RESPONSE ACTION(S) AND COST(S)				Estimated Costs	
<input checked="" type="checkbox"/> A. OPERATION AND MAINTENANCE				\$ 15.00	
<input type="checkbox"/> B. REPAIR				\$	
<input checked="" type="checkbox"/> C. ENCAPSULATION				\$ 5.00	
<input type="checkbox"/> D. ENCLOSURE				\$	
<input type="checkbox"/> E. REMOVAL				\$	
TOTAL				\$ 20.00	
5. NARRATIVE OF RECOMMENDED RESPONSE ACTIONS					
Schedule					
			start	complete	
The condition of the tape is fair. Access to this area is only permitted by authority personnel. To decrease any amount of asbestos fiber release, spray tape with an encapsulant to seal all fibers. Will reevaluate condition of tape at next inspection.			7-9-89	7-9-90	

PHYSICAL AND HAZARD ASSESSMENT OF FRIABLE
ACBM OR FRIABLE ASSUMED ACBM (Form C)
(SEC. 763.93)

9C1

			CDS CODE 10-62166-6933691
SCHOOL Fresno SDA Academy			School Phone # (209)251-5548
ADDRESS	(NUMBER) 5397 E. Olive Ave.	(CITY) Fresno	(ZIP CODE) 93727

BUILDING NAME 59-Furnace Rm. in Arts and Music Bldg.	INSPECTION DATE 10-20-88
---	-----------------------------

FUNCTIONAL SPACE 9-59-P-T (furnace rm.)	INDICATE LINE # FROM FORM B 2
--	----------------------------------

TYPE OF FRIABLE ACBM	SURFACING	<input checked="" type="checkbox"/> TSI	MISCELLANEOUS
----------------------	-----------	---	---------------

1. CONDITION OF ACBM (OVERALL RATING)

☒ GOOD ☐ DAMAGED ☐ SIGNIFICANTLY DAMAGED

POTENTIAL FOR DISTURBANCE (Overall Rating)

☒ LOW ☐ MODERATE ☐ HIGH

3. HAZARD ASSESSMENT (Combine ratings from items 1 and 2 and check appropriate box)

CONDITION OF ACBM	Potential for Disturbance		
	LOW	MODERATE	HIGH
GOOD	X		
DAMAGED			
SIGNIFICANTLY DAMAGED			

4. RECOMMENDED RESPONSE ACTION(S) AND COST(S)	Estimated Costs
<input checked="" type="checkbox"/> A. OPERATION AND MAINTENANCE	\$ 15.00
<input type="checkbox"/> B. REPAIR	\$
<input checked="" type="checkbox"/> C. ENCAPSULATION	\$ 5.00
<input type="checkbox"/> D. ENCLOSURE	\$
<input type="checkbox"/> E. REMOVAL	\$
TOTAL	\$ 20.00

5. NARRATIVE OF RECOMMENDED RESPONSE ACTIONS

Schedule

	start	complete
The pipe insulation is in good condition. Access in here is only permitted by authority personnel. To decrease any amount of asbestos fiber release, spray pipe insulation with an encapsulant to seal all fibers. Pipe insulation will be reevaluated at next inspection.	7-9-89	7-9-90

PHYSICAL AND HAZARD ASSESSMENT OF FRIABLE
ACBM OR FRIABLE ASSUMED ACBM (Form C)
(SEC. 763.93)

9C2

			CDS CODE 10-62166-6933691
SCHOOL Fresno SDA Academy			School Phone # (209)251-5548
ADDRESS	(NUMBER) 5397 E. Olive Ave.	(CITY) Fresno	(ZIP CODE) 93727

BUILDING NAME 59-Furnace Rm. in Arts and Music Bldg.	INSPECTION DATE 10-20-88
---	-----------------------------

FUNCTIONAL SPACE 9-59-TI (furnace rm.)	INDICATE LINE # FROM FORM B 3
---	----------------------------------

TYPE OF FRIABLE ACBM	SURFACING	<input checked="" type="checkbox"/> TSI	MISCELLANEOUS
----------------------	-----------	---	---------------

1. CONDITION OF ACBM (OVERALL RATING)

☐ GOOD ☐ DAMAGED ☒ SIGNIFICANTLY DAMAGED

2. POTENTIAL FOR DISTURBANCE (Overall Rating)

☒ LOW ☐ MODERATE ☐ HIGH

3. HAZARD ASSESSMENT (Combine ratings from items 1 and 2 and check appropriate box)

CONDITION OF ACBM	Potential for Disturbance		
	LOW	MODERATE	HIGH
GOOD			
DAMAGED			
SIGNIFICANTLY DAMAGED	X		

4. RECOMMENDED RESPONSE ACTION(S) AND COST(S)	Estimated Costs
<input checked="" type="checkbox"/> A. OPERATION AND MAINTENANCE	\$ 15.00
<input checked="" type="checkbox"/> B. REPAIR	\$ 75.00
<input type="checkbox"/> C. ENCAPSULATION	\$
<input type="checkbox"/> D. ENCLOSURE	\$
<input checked="" type="checkbox"/> E. REMOVAL	\$ 225.00
TOTAL	\$ 315.00

5. NARRATIVE OF RECOMMENDED RESPONSE ACTIONS	Schedule	
	start	complete
The joint compound in the furnace room is in poor condition. This needs to be repaired or removed completely and replaced with another joint compound that does not contain asbestos. Fibers are being released readily because of the poor condition.	7-9-89	1-9-90

PHYSICAL AND HAZARD ASSESSMENT OF FRIABLE
ACBM OR FRIABLE ASSUMED ACBM (Form C)
(SEC. 763.93)

9C3

SCHOOL Fresno SDA Academy			CDS CODE 10-62166-6933691
ADDRESS (NUMBER) 5397 E. Olive Ave. (CITY) Fresno (ZIP CODE) 93727			School Phone # (209)251-5548

BUILDING NAME 59-Furnace Rm. in Arts and Music Bldg.	INSPECTION DATE 10-20-88
---	-----------------------------

FUNCTIONAL SPACE 9-59-6 (furnace rm.)	INDICATE LINE # FROM FORM B 4
--	----------------------------------

TYPE OF FRIABLE ACBM	SURFACING	<input checked="" type="checkbox"/> TSI	MISCELLANEOUS
----------------------	-----------	---	---------------

1. CONDITION OF ACBM (OVERALL RATING)

☐ GOOD ☒ DAMAGED ☐ SIGNIFICANTLY DAMAGED

2. POTENTIAL FOR DISTURBANCE (Overall Rating)

☒ LOW ☐ MODERATE ☐ HIGH

3. HAZARD ASSESSMENT (Combine ratings from items 1 and 2 and check appropriate box)

CONDITION OF ACBM	Potential for Disturbance		
	LOW	MODERATE	HIGH
GOOD			
DAMAGED	X		
SIGNIFICANTLY DAMAGED			

4. RECOMMENDED RESPONSE ACTION(S) AND COST(S)	Estimated Costs
<input checked="" type="checkbox"/> A. OPERATION AND MAINTENANCE	\$ 15.00
<input type="checkbox"/> B. REPAIR	\$
<input checked="" type="checkbox"/> C. ENCAPSULATION	\$ 5.00
<input type="checkbox"/> D. ENCLOSURE	\$
<input type="checkbox"/> E. REMOVAL	\$
TOTAL	\$ 20.00

5. NARRATIVE OF RECOMMENDED RESPONSE ACTIONS	Schedule	
	start	complete
Putting on an encapsulant will seal up the asbestos fibers. This will meet the AHERA requirements until the condition worsens and then the gasket can be replaced. Will reevaluate at next inspection.	7-9-89	7-9-90

OPERATIONS AND MAINTENANCE PROGRAM
(FORM D)

9

CDS CODE
10-62166-6933691

SCHOOL

Fresno SDA Academy

SCHOOL PHONE #
(209)251-5548

ADDRESS

(number) (street)
5397 E. Olive Ave.

(city)
Fresno

(zip code)
93727

For each area where friable ACBM is present, assumed to be present, or is about to become present, write an operations and maintenance (O & M) program.

This O & M program must be developed for the entire school. The program must describe worker protection, initial and additional cleaning programs, building occupant protection (access control, signs, control of air movement, work practices, area cleaning, disposal methods), design and performance of other than small-scale, short-duration maintenance activities, and activities associated with minor and major fiber release episodes (Sec. 763.91).

IMPORTANT

Use Forms E through H to describe specific elements of this program. Use additional sheets when necessary.

All friable asbestos is found in the furnace room. The following procedures for cleaning should be followed. The ACBM in lines 5,6,& 7 of form B is nonfriable. Abstain from scraping, sanding, or anything that would cause the ACBM to become friable. If the condition changes and becomes friable, then the following steps will have to apply to them also.

INITIAL CLEANING:

Custodial Staff should:

Mop all non-carpeted floors with wet mops. Wipe all shelves and other horizontal surfaces with damp cloths. Use a mist spray bottle to keep cloths damp. Discard cloths and mop heads in sealed plastic bags according to EPA regulations for disposal of asbestos waste.

MONTHLY CLEANING:

Custodial Staff should:

Spray with water and debris found near surfacing ACM and place the debris in plastic bags using a dust pan. Rinse the pan with water in a utility sink. Report presence of debris immediately to the O&M Program Coordinator.

Wet-mop all other floors and wipe all other horizontal surfaces with damp cloths.

Dispose of all debris, filters, mop heads, and cloths in plastic bags according to EPA regulations for disposal of asbestos waste.

* Please note following page: "A GUIDE FOR REDUCING ASBESTOS EXPOSURE"

MONTHLY CLEANING:

Custodial Staff should:

Spray with water any debris found near surfacing ACM and place the debris in plastic bags using a dust pan. Rinse the pan with water in a utility sink. Report presence of debris immediately to the O&M Program Coordinator.

HEPA-vacuum all carpets.

Wet-mop all other floors and wipe all other horizontal surfaces with damp cloths.

Dispose of all debris, filters, mop heads, and cloths in plastic bags according to EPA regulations for disposal of asbestos waste.

The response action for any maintenance activities disturbing friable ACBM, other than small-scale, short-duration maintenance activities, shall be designed by persons accredited to design response actions and conducted by persons accredited to conduct response actions.

The local education agency shall ensure that the procedures described below are followed in the event of a minor fiber release episode (i.e., the falling or dislodging of 3 square or linear feet or less of friable ACBM):

- (1) Thoroughly saturate the debris using wet methods.
- (2) Clean the area with HEPA-vacuum or steam-clean carpets, HEPA-vacuum or wet-clean all other floors and all other horizontal surfaces.
- (3) Place the asbestos debris in a sealed, leak-tight container.
- (4) Repair the area of damaged ACM with materials such as asbestos-free spackling, plaster, cement, or insulation, or seal with latex paint or an encapsulant, or immediately have the appropriate response action implemented as required by Sec. 763.90.

The local education agency shall ensure that the procedures described below are followed in the event of a major fiber release episode (i.e., the falling or dislodging of more than 3 square or linear feet of friable ACBM):

- (1) Restrict entry into the area and post signs to prevent entry into the area by persons other than those necessary to perform the response action.
- (2) Shut off or temporarily modify the air-handling system to prevent the distribution of fibers to other areas in the building.
- (3) The response action for any major fiber release episode must be designed by persons accredited to design response actions and conducted by persons accredited to conduct response actions.

* Please note following page: "A GUIDE FOR REDUCING ASBESTOS EXPOSURE"

A GUIDE FOR REDUCING ASBESTOS EXPOSURE

PURPOSE

Your school building contains materials which contain asbestos and may release fibers into the air. Breathing asbestos fibers is dangerous. This fact sheet tells how to reduce exposure to asbestos fibers. Please read it carefully.

PROTECTING YOURSELF FROM ASBESTOS

Some of the friable building materials in your school contain asbestos. Friable asbestos-containing materials crumble easily and release fibers into the air. Breathing these fibers may cause cancer and other diseases. The more asbestos you breathe, the greater your chances are of getting disease. You can take precautions that will reduce or eliminate the risk of being exposed to asbestos.

Find out from your supervisor where these friable asbestos-containing materials are in your building. Do not touch or disturb them unless you have to. If you must handle an asbestos-containing material, first lightly spray it with water, (EPA recommends using water which contains wetting agents, if they are available,) Wet asbestos-containing material will not release as many fibers.

Even if friable asbestos-containing materials are not disturbed, they may release asbestos fibers, which will fall slowly to the floor. If you are cleaning in areas which contain these materials, do not use a broom: it will stir the fibers into the air. Do not use a vacuum cleaner unless it is equipped with a High Efficiency Particulate Absolute filter. The fibers are so small they can pass through an ordinary vacuum cleaner and out into the room.

When cleaning in areas which contain friable asbestos-containing materials, use dampened mops and dustcloths. Dampened mops and dustcloths will hold the fibers much better than dry mops and dustcloths, and will reduce the number of fibers put back into the air. It is best to use mops with disposable heads and to throw away the mop head after use. Otherwise fibers will be released as the mop dries. Use either lightly dampened mops or cloths or a vacuum with a High Efficiency Particulate Absolute filter to clean areas where wet mopping cannot be used (such as carpeting or hardwood floors).

Clean tables and chairs in the area with damp cloths. Do not dust them with brushes or with dry cloths, and do not vacuum them.

After you use the mop heads and cloths, put them in a plastic bag while they are still wet. Dislodged materials should also be placed in plastic bags for disposal.

A LIST OF IMPORTANT POINTS TO REMEMBER

1. Do not handle or disturb friable asbestos containing materials unless necessary.
2. If you must handle asbestos-containing materials, wet them first.
3. If you must disturb asbestos (for example, to repair a light), see your supervisor before starting work. Then:
 - a. Place a plastic dropcloth below the work area.
 - b. Spray asbestos-containing material with water before you disturb it.
 - c. Make sure that only those persons who are necessary for the job are in the area.
 - d. Put all the asbestos you remove into a heavy plastic bag. Seal the bag and discard it.
 - e. After the job, clean all the ladders and tools you used with a wet cloth.
 - f. Roll up the dropcloth carefully and put it in a plastic bag. Discard the bag.
 - g. Clean the floor below the work area with a wet mop.
 - h. Put the mop head and the cloth used to clean the ladders in a plastic bag while they are still wet, seal the bag, and discard it.
4. If you must disturb or remove large sections of asbestos-containing material, see your supervisor before you begin. The National Institute for Occupational Safety and Health recommends that a respirator approved for toxic dusts be worn during such work.

You should make arrangements to turn off the school's ventilation system if you are disturbing or removing large sections of asbestos-containing material. The ventilation system should remain off until the work is completed and the area has been cleaned.

PERIODIC SURVEILLANCE PLAN
(FORM E)

9

				CDS CODE 10-62166-6933691
SCHOOL Fresno SDA Academy				SCHOOL PHONE # (209)251-5548
ADDRESS	(number)	(street)	(city)	(zip code)
	5397	E. Olive Ave.	Fresno	93727

This plan must include a periodic surveillance of each building with friable ACBM and nonfriable ACBM at least every six months. The person performing periodic surveillance must receive two hours general training and 14 hours of additional training if work performed might disturb asbestos. The person will record the date, the area of inspection, the inspector's name, the description of any changes of the materials, and also visual inspect the areas(Sec. 763.92).

Persons dealing with disturbed ACBM must have at least 16 hours of training in dealing and handling ACM. Inspection must be done every six months or by July 9,1989 and every six months there after with a three year inspection by a certified state inspector or by July 9, 1992.

PERIODIC INSPECTION

Building inspectors should:

Inspect all ACM materials for damage or deterioration at least twice a year and report findings to the O&M program coordinator.

Investigate the source of debris found by the custodial staff.

Custodial and maintenance staff should:

Inform the O&M program coordinator when damage to ACM is observed or when debris is cleaned up.

NOTE the attached: "Reassessment of Asbestos-Containing Materials"
"Training and Periodic surveillance".

REASSESSMENT OF ASBESTOS-CONTAINING MATERIALS

Location of asbestos-containing material(s) (address, building, room(s),
or general description: _____

Type of asbestos-containing material(s):

1. Sprayed or troweled on ceilings or walls.
2. Sprayed or troweled on structural members.
3. Insulation on pipes, tanks, or boilers.
4. Other (describe): _____

Abatement Status:

1. The material has been encapsulated _____, enclosed _____
neither _____.

Assessment:

1. Evidence of physical damage: _____

2. Evidence of water damage: _____

3. Evidence of delamination or other deterioration: _____

4. Degree of accessibility of the material: _____

5. Degree of activity near the material: _____

6. Location in an air plenum, air shaft, or air stream: _____

7. Other observations (including the condition of the encapsulant or
enclosure, if any): _____

Signed: _____ Date: _____
(Evaluator)

Sec. 763.92 Training and periodic surveillance.

(a) *Training.* (1) The local education agency shall ensure, prior to the implementation of the O&M provisions of the management plan, that all members of its maintenance and custodial staff (custodians, electricians, heating/air conditioning engineers, plumbers, etc.) who may work in a building that contains ACBM receive awareness training of at least 2 hours, whether or not they are required to work with ACBM. New custodial and maintenance employees shall be trained within 60 days after commencement of employment. Training shall include, but not be limited to:

- (i) Information regarding asbestos and its various uses and forms.
- (ii) Information on the health effects associated with asbestos exposure.
- (iii) Locations of ACBM identified throughout each school building in which they work.
- (iv) Recognition of damage, deterioration, and delamination of ACBM.
- (v) Name and telephone number of the person designated to carry out general local education agency responsibilities under Sec. 763.84 and the availability and location of the management plan.

(2) The local education agency shall ensure that all members of its maintenance and custodial staff who conduct any activities that will result in the disturbance of ACBM shall receive training described in paragraph (a)(1) of this section and 14 hours of additional training. Additional training shall include, but not be limited to:

- (i) Descriptions of the proper methods of handling ACBM.
- (ii) Information on the use of respiratory protection as contained in the EPA/NIOSH *Guide to Respiratory Protection for the Asbestos Abatement Industry*, September 1986.
- (iii) Hands-on training in the use of respiratory protection, other personal protection measures, and good work practices.

(3) Local education agency maintenance and custodial staff who have attended EPA-approved asbestos training or received equivalent training for O&M and periodic surveillance activities involving asbestos shall be considered trained for the purposes of this section.

(b) *Periodic surveillance.* (1) At least once every 6 months after a management plan is in effect, each local education agency shall conduct periodic surveillance in each building that it leases, owns, or otherwise uses as a school building that contains ACBM or is assumed to contain ACBM.

(2) Each person performing periodic surveillance shall:

- (i) Visually inspect all areas that are identified in the management plan as ACBM or assumed ACBM.
- (ii) Record the date of the surveillance, his or her name, and any changes in the condition of the material.
- (iii) Submit to the person designated to carry out general local education agency responsibilities under Sec. 763.84 a copy of such record for inclusion in the management plan.

REINSPECTION PLAN
(FORM F)

9

				CDS CODE 10-62166-6933691
SCHOOL Fresno SDA Academy				SCHOOL PHONE # (209)251-5548
ADDRESS	(number)	(street)	(city)	(zip code)
	5397	E. Olive Ave.	Fresno	93727

The plan must meet the reinspection requirements of Section 763.85. This plan will include a reinspection every three years by an accredited inspector.

The school must be reinspected in three years or by July 9, 1992 by a Certified Inspector, and every six months by a local inspector, documenting the conditions and state of ACM. Any changes must be documented, giving date of inspection and name of inspector.

Note: Please note the following page, REINSPECTION.

REINSPECTION;

1. At least once every 3 years after a management plan is in effect, each local education agency shall conduct a reinspection of all friable and nonfriable known or assumed ACBM in each school building that they lease, own, or otherwise use as a school building.
2. Each inspection shall be made by an accredited inspector.
3. For each area of a school building, each person performing a reinspection shall:

Visually reinspect, and reassess, under Sec. 763.88, the condition of all friable known or assumed ACBM.

Visually inspect material that was previously considered nonfriable ACBM and touch the material to determine whether it has become friable since the last inspection.

Identify and homogeneous areas with material that has become friable since the last inspection.

For each homogeneous area of newly friable material that is already assumed to be ACBM, bulk samples may be collected and submitted for analysis in accordance with Sec. 763.86 and 763.87.

Assess, under Sec. 763.88, the condition of the newly friable material in areas where samples are collected, and newly friable materials in areas that are assumed to be ACBM.

Reassess, under Sec. 763.88, the condition of friable known or assumed ACBM previously identified.

Record the following and submit to the person designated under Sec. 763.84 a copy of such record for inclusion in the management plan within 30 days of the reinspection:

1. The date of the reinspection, the name and signature of the person making the reinspection, State of accreditation, and if applicable, his or her accreditation number, and any changes in the condition of known or assumed ACBM.
2. The exact locations where samples are collected during the reinspection, a description of the manner used to determine sampling locations, the name and signature of each accredited inspector who collected the samples, State of accreditation, and, if applicable, his or her accreditation number.
3. Any assessments or reassessments made of friable material, the name and signature of the accredited inspector making the assessments, State of accreditation, and, if applicable, his or her accreditation number.

PARENT/EMPLOYEE NOTIFICATION PROGRAM
(FORM G)

9

					CDS CODE 10-62166-6933691
SCHOOL Fresno SDA Academy					SCHOOL PHONE # (209)251-5548
ADDRESS	(number)	(street)	(city)	(zip code)	
	5397	E. Olive Ave.	Fresno	93727	

In the discussion section of this form, information should be included that describes steps taken to inform workers and building occupants, or their legal guardians, about inspections, response actions, and post response action activities, including periodic reinspection and surveillance activities that are planned or in progress. Notifications must be made once each school year (Sec. 763.84).

Send a letter similar to the one enclosed to all parents, teachers, workers, and or legal guardian of all students. This letter must go out annually. A signed copy and every updated copy of this letter needs to be attached to this management plan. If your school does not contain ACBM this letter still needs to be sent out annually. Inform them that the school has been inspected for asbestos according with EPA regulations and a report is located at a centralized location at the administration office of the school and at the LEA's office for all to review. (Please note the attached form "Notice to School Employees".) This notification must remain until all ACBM is removed from the school. Please make sure your staff; teachers, workers, & custodial persons are aware of this report and where it can be found for review.

Dear Parents, Teachers, Workers, or Legal Guardians:

Our school has been inspected for asbestos containing building material (ACBM) according with EPA regulations. If you have any questions, please come in at your convenience and look over the management plan which is located at the administrative office here at the school and at the LEA's office in Clovis.

This report and all records regarding AHERA activities will be maintained at a centralized location and will be made available to you so that you can more fully understand what plans or actions are in progress concerning: inspections, response actions, post response action activities, periodic reinspection and surveillance activities.

Thank you for your continual support in christian education.

(Principal)

NOTICE TO SCHOOL EMPLOYEES

In accordance with EPA regulations, this school has been inspected for friable (easily crumbled) and non-friable materials which contain asbestos. Friable asbestos-containing material may cause health problems.

Friable and non-friable asbestos-containing material is present in

(Name of School)

A record of the inspection, a diagram of the location(s) of friable and non-friable asbestos-containing materials, and a copy of relevant EPA regulations are available in:

(building)

(room)

For further information, interested persons should call 800-424-9065 (554-1404 in the Washington, DC area).

Signed:

(Name)

(title)

Date

VALUATION OF RESOURCES NEEDED
(FORM H)

9

				CDS CODE 10-62166-6933691
SCHOOL Fresno SDA Academy				SCHOOL PHONE # (209)251-5548
ADDRESS	(number)	(street)	(city)	(zip code)
	5397	E. Olive Ave.	Fresno	93727
estimated total cost of response actions \$ 375.00	estimated total cost of inspections \$ 2282.28		estimated total cost of management plan \$ 1141.14	

Discussion should include such information as funding required, equipment, facilities, support personnel (Sec. 763.93).

FUNDING REQUIRED

40 CFR Part 763 Final Rule and Notice:

V. Economic impact

The cost of an asbestos inspection is estimated to range from \$1,144 to \$1,627 per school for schools with both surfacing and thermal systems insulation ACM. This cost varies depending upon the size of the school, the amount and type of ACM contained in the school, and the type of professional doing the work. The costs of sampling and analysis if friable materials are found will depend upon the number of samples taken and analyzed. Costs of analysis are estimated to range from \$25 to \$47 per sample. Assuming the average school has an analyze 20 samples, the cost of analysis will be \$500 to \$940 per school. The cost of mapping ACM is estimated to range from \$110 to over \$270 per school.

The cost of developing a management plan is asbestos-containing surfacing ACM or thermal systems insulation ACM is present is estimated to range from \$1,025 for an average-size public primary school to \$1,420 for an average size public secondary school. These estimates are weighted average of the costs of plans developed by trained school personnel and by outside consultants.

The cost of training for school employees involves a variety of factors ranging from course and accreditation exam fees to the possible expenses for any out of town travel required for the training. The estimated course fee for a 2-hour awareness session required of all school maintenance employees in schools with ACM is approximately \$50 per person., The additional 14 hours of training for school maintenance workers who may come in contact with asbestos in doing minor repair and maintenance work that disturbs asbestos is estimated to cost \$250. A fee of \$420 is estimated for the 24 hours of training required for the certification of asbestos abatement workers doing more than just minor repair and small glove-bag removal jobs. The fee for the 40-hour training course and certification required for asbestos abatement contractors is estimated to be \$640.

Response action costs depend primarily on the condition of the asbestos in a school and to a lesser extent on many other factors. In general, for surfacing ACM in all but the significantly damaged category, it is likely that the primary response action undertaken by a school will be special O&M activities. Use of O&M activities would likely continue until or unless the ACM deteriorates to a "significantly damaged" condition. The annual cost of a special O&M program (excluding acquisition of special equipment) is estimated to range from \$3,800 for a typical public primary school to \$5,100 for a typical public secondary school. Initial cleaning costs are expected to range from \$950 to \$1,400.

The cost of removal depends upon many factors including size of the project. The estimated cost of removal for a 4,000 sq. ft. project in which surfacing material is removed would be approximately \$51,300. The cost of removal for a 900 sq. ft. boiler wrap project is estimated to be approximately \$30,900. The total discounted costs of response actions were estimate assuming schools undertake a combination of response actions that depend on the condition of the ACM.

EQUIPMENT

For handling small removal jobs of 32 sq. ft. or less or cleaning of ACM, the following will be needed:

- Gloves
- Glove bags (depending on the type of removal)
- Tyvecs (disposable coveralls)
- Negative air mask respirator
- Nepa-filter vacuum cleaner
- Plastic sheeting
- Plastic bags ("Danger-Asbestos")

For more information about Asbestos safety order:

ENVIRONMENTAL PROTECTION AGENCY (EPA)

General Asbestos Info: Library: (415) 974-8076

Technical Assistance: Schools: (415) 974-7551, -7056

NESHAP for removal & demolition regulations, for contractors, building owners:

1. Local Air Pollution Control (delegated local authority for NESHAP regs.)

Bay Area: (F.S. Alameda, Contra Costa, Marin, Napa, San Mateo, Santa Clara, Sonoma & Solano): (415) 771-6000

Other counties: "name of county Air Pollution Control District".

2. Emergency Notifications: Local APCD (above) and Janet Crawford, EPA NESHAPs Coordinator: (415) 974-7633

CONSULTANT list: 1. In phone books under "Industrial Hygienists of Asb. Consultants"

2. By calling American Lung Association for their list

a. San Francisco Office: (415) 543-4410

b. Los Angeles Office: (213) 935-5864

3. Listed in "American Indust. Hygiene Assoc. Journal" in January ;and July issues: (216) 762-7294

4. Pamphlet: ASBESTOS SAFETY EQUIPMENT

100 Gall Drive Suite #4

Novato, Ca. 94949

ph. (415) 892-9359

FACILITIES

Disposal Waste Dumps:

Berkeley: (415) 540-2043

Sacramento: (916) 739-3145

Fresno: (209) 445-5938

Contact Mr. Milton Thorman, (209) 291-7700, for information about the nearest drop sight for all your asbestos.

SUPPORT PERSONNEL

PACIFIC ASBESTOS INFORMATION CENTER: UC Berkeley Ext. courses: (415) 643-7143

OSHA: Worker Protection, enforcement and Industrial Hygiene consultation:

Federal OSHA: Toll free general info: (800) 648-1003

CAL/OSHA: Clovers State employees only: gen. consultation: (415) 557-1946

AHERA: For management of AHERA regulations, to provide lists of accredited persons, to receive the Management plans: California: (916) 445-9327.

NESHAPS: National Emissions Standards for Hazardous Air Pollutants regulates the emission of asbestos fibers for handling of asbestos in most buildings, and the disposal of asbestos-containing waste. The EPA/NESHAPS must be notified before the beginning of any project of more than 160 sq. ft. or 260 linear feet. Notify by mail to Ms. Janet Crawford A-3-3, NESHAPS Coordinator, NESHAPS A-3-3. EPA Region 9, 215 Fremont St. S.F., CA., 94105.

Air pollution Control District (APCD): These local agencies have been delegated primary authority to enforce EPA/NASHAP regulations. Contract the nearest county agency for information and notification requirements for asbestos projects.
BAAQMD: 415) 771-6000.

The following providers have either full or contingent approval in Region 9. Successful completion of either a fully approved course or a contingently approved course provides full accreditation for course attendees. Only if EPA subsequently withdrew contingent approval would future course offering not have EPA approval.

- * ABMS/Excel Environ. Inc., Oakland, CA (415) 547-7144. Contingent approval: Workers; Contractor/Supervisors
- * Center for Accelerated Learning, Vacaville, CA. (707) 446-7996. Contingent approval: Contractor/Supervisors; Workers.
- * Insulators and Asbestos Industry of Northern California, Alameda, CA. (415) 522-7048.
- * IT Corp., Wilmington, CA. (213) 830-1781. Contingent approval: Workers; Contractor/Supervisors
- * Kellco, Fremont, CA. (415) 659-9751. Contingent approval: Workers.
- * Med-Tox, Tusting CA. (714) 259-0620. Contingent approval; Inspector; Contractor/Supervisor; Workers.

* Napier & Associates, Torrance, CA. (213) 644-1924. Contingent approval:
Workers.

* Pacific Asbestos Information Center, Berkeley Extension, CA. (415) 643-7143.
Full approval: Inspector/Management planner; Contractor/Supervisor.

EPA-ACCREDITED COURSES FROM OTHER REGIONS AVAILABLE IN CALIFORNIA

Telephone providers for schedules and information.

* Clayton Envir. Conslt.
(415) 426-2600
Inspector/Mgmt.Planner

* Kaselaan & D'Angelo Assoc.
(213) 324-6825
Inspector/Mgmt.Planner

* Critical Environmental
Training, Texas:
(800) 527-1830
Contractor/Supervisor; Workers

* Local 22, Texas
Internt. Assoc. Of Heat & Frost
(713) 473-0888
Contractor/Supervisor, Workers

* Environmental Instit., Texas
(214) 553-8866
Inspector/Mgmt. Planner
Contractor/Supervisor

* NAC (National Asb. Council)
(404) 292-0629
Workers

Hall-Kimbrell, Kansas
(800) 364-2860
Contractor/Supervisor,
Workers, Project Designer

* North West Envirocon, Or.
(503) 659-8899
Inspector/Mgmt.Planner

* IPC, Illinois
(312) 975-3495
Workers

* White Lung, Maryland
(415) 668-2594
(707) 839-9270
Inspector/Mgmt.Planner

RECORDKEEPING

REQUIREMENT

All records shall be maintained in a centralized location in the administrative office of both the school and the local education agency as part of the management plan. For each homogeneous area where all ACBM has been removed, the local education agency shall ensure that such records are retained for 3 years after the next reinspection required under Sec. 763.85 or for an equivalent period.

For each preventive measure and response action taken for friable and nonfriable ACBM and friable and nonfriable suspected ACBM assumed to be ACM, the local education agency shall provide;

(1) A detailed written description of the measure or action, including methods used, the location where the measure or action was take, reasons for selecting the measure or action, start and completion dates of the work, names and addresses of all contractors involved, and if applicable, their State of accreditation, and accreditation numbers, and if ACBM is removed, the name and location of storage or disposal site of the ACM.

(2) The name and signature of any person collecting any air sample required to be collected at the completion of certain response actions specified by Sec. 763.90, the locations where samples were collected, date of collection, the name and address of the laboratory analyzing the samples, the date of analysis, the results of the analysis, the method of analysis, the name and signature of the person performing the analysis, and a statement that the laboratory meets the applicable requirements of Sec. 763.90.

For each person required to be trained under Sec. 763.92 (a) 1 & 2, the local education agency shall provide the person's name and job title, the date that training was completed by that person, the location of the training, and the number of hours completed in such training.

For each time that periodic surveillance under Sec. 763.92 (b) is performed, the local education agency shall record the name of each person performing the surveillance, the date of the surveillance, and any changes in the conditions of the materials.

For each time that cleaning under Sec. 763.91 (c) is performed, the local education agency shall record the name of each person performing the cleaning, the date of such cleaning, the locations cleaned, and the methods used to perform such cleaning.

For each time that operations and maintenance activities under Sec. 763.91(d) are performed, the local education agency shall record the name of each person performing the activity, the start and completion dates of the activity, the locations where such activity occurred, a description of the activity including preventive measures used, and if ACBM is removed, the name and location of storage or disposal sit of the ACM.

For each time that major asbestos activity under Sec. 763.91 (e) is performed, the local education agency shall provide the name and signature, State of accreditation, and if applicable, the accreditation number of each person performing the activity, the start and completion dates of the activity, the locations where such activity occurred, a description of the activity including preventive measures used, and if ACBM is removed, the name and location of storage or disposal site of the ACM.

For each fiber release episode under Sec. 763.91 (f), the local education agency shall provide the date and location of the episode, the method of repair, preventive measures or response action taken, the name of each person performing the work, and if ACBM is removed, the name and location of storage or disposal site of the ACM.

PERMIT APPLICATION FOR PERFORMING MAINTENANCE/RENOVATION WORK

1. Exact location of area involved (including building number, room number, location within room, etc.) _____

2. Description of work involved _____

3. Starting Date _____ Anticipated Completion Date _____
4. * Approximate amount of asbestos present (linear feet, square feet, size of tank, etc.) _____

5. * Asbestos control methods to be used (i.e., glove bag, HEPA vacuum, wet methods, etc.) _____

6. * Protective equipment to be used (respirator, coveralls, etc.) _____

7. Name and telephone number/extension of supervisor. _____

TO BE FILLED OUT BY ASBESTOS PROGRAM MANAGER

Permit _____ Accepted _____ Rejected _____
Signed _____ Print _____
Permit Number _____
Emergency Contact _____

Please return this form to:

Eslinger's Enterprise
9535 Arroya Rd.
Dos Palos, Ca. 93620

* Note; These items may have to be filled out by asbestos program manager.

FIBER RELEASE EPISODE REPORT

1. Address, building, and room number(s) (or description of area) where episode occurred: _____

2. The release episode was reported by _____
on _____ (date)
3. Describe the episode: _____

4. The asbestos-containing material was _____/ was not _____
cleaned up according to approved procedures. Describe the cleanup:

Signed: _____
(Asbestos Program Manager)

Date: _____

ASBESTOS HAZARD EMERGENCY RESPONSE ACT (AHRA)
GENERAL DATA (FORM A)

LOCAL EDUCATION AGENCY Central California Conference of SDA			County Fresno
SCHOOL NAME Fresno SDA Elementary			Phone number (209)251-5548
ADDRESS (number) 5397	(street) E. Olive Ave.	(city) Fresno	(zip code) 93727

CDS Code 10-62166-6933691	School Enrollment 211	# of Employees 10	# of Buildings 2
------------------------------	--------------------------	----------------------	---------------------

LEA AHRA DESIGNEE

NAME ESLINGER ENTERPRISES HERBERT J. ESLINGER - GILBERT D. ESLINGER	Phone number 209-387-4375
---	------------------------------

Address (number) 9545 West Hwy 152	(street)	(city) Dos Palos	(zip code) 93620
---------------------------------------	----------	---------------------	---------------------

Training Course(s) & Date(s)	Hours	Total Training hr. 112 HRS.
Competent person - March 8-11	32	
Certified Worker - March 21-25	40	
Inspector & Mgt./Planner - May 2-6	40	

MANAGEMENT PLANNER

Name Herbert J. Eslinger	Phone number 209-387-4375
-----------------------------	------------------------------

Address (number) 9545 West Hwy. 152	(street)	(city) Dos Palos	(zip code) 93620
--	----------	---------------------	---------------------

Accreditation # MP 2107 88 MP 2108 88	Training Agency Northwest Envirocon, Portland
--	--

Documents Attached

No form of asbestos has been detected in this school.

We certify that the general Local Education Agency (LEA) responsibilities, as stipulated by 40CFR Part 763, have been met or will be met, and that this submit-til includes all buildings at this school.

Management Planner Signature Herbert J. Eslinger	Date 1-9-89
LEA Designee Signature Herbert J. Eslinger	Date 1-9-89
LEA Superintendent Signature M.E. THORMAN, Ed. Sec.	Date 1-9-89

OFFICE OF LOCAL ASSISTANCE USE ONLY

Date Returned	Date Resubmittal Received	(date stamp)
---------------	---------------------------	--------------

Reason(s) For Return

Printed Name of Reviewer

Date

ESLINGER ENTERPRISES

The following Inspection Report was completed by Herbert and Gilbert Eslinger.
Samples were taken randomly and in areas of convenience and inconspicuously according
to Sec. 763.86 of the Federal Register.

Date: 10-20-88

Herbert Eslinger I-1107-88
Herbert Eslinger (accreditation #)

Gilbert Eslinger I-1108-88
Gilbert Eslinger (accreditation #)

The holder of this card has successfully completed the training needed to comply with AHERA regulations 40 CFR 763 and TSCA Title II.

Instructor Signature

Robert E. Hastings

The holder of this card has successfully completed the training needed to comply with AHERA regulations 40 CFR 763 and TSCA Title II.

Instructor Signature

Robert E. Hastings

NOTICE

IF YOU WORK ON AN ASBESTOS REMOVAL OR ENCAPSULATION PROJECT, YOU MUST BE PREPARED AT ANY TIME TO SHOW THIS CARD TO AN INSPECTOR. YOU CANNOT LET ANYONE ELSE USE THIS CARD. YOU MUST TAKE A REFRESHER COURSE BEFORE APPLYING FOR A RENEWAL OF THIS CARD

NOT VALID UNTIL SIGNED

Gilbert Eslinger

Northwest Envirocon, Inc.



NAME
GILBERT ESLINGER
I.D.# — CERT.#
I-1108-88
BIRTHDATE EXP. DATE
04/17/51 05/04/89
CERTIFICATION TYPE
ACCREDITED INSPECTOR

Northwest Envirocon, Inc.



NAME
GILBERT ESLINGER
I.D.# — CERT.#
MP-2108-88
BIRTHDATE EXP. DATE
04/17/51 05/06/89
CERTIFICATION TYPE
ACCREDITED MGT/PLANNER

Department of
LABOR & INDUSTRIES

Division of
INDUSTRIAL SAFETY & HEALTH

CERTIFIED ASBESTOS WORKER



NAME
Gilbert Eslinger
CERTIFICATION NO.
E7393
CERTIFICATE NO.
3043 W
EXPIRATION DATE
04/17/51
03/25/90
JOSEPH A. DEAR, DIRECTOR
Joseph A. Dear



NAME
HERBERT J. ESLINGER

I.D.# CERT.#
1-1107-88

BIRTHDATE EXP. DATE
12/29/22 05/04/89

CERTIFICATION TYPE
ACCREDITED INSPECTOR

NOTICE

IF YOU WORK ON AN ASBESTOS REMOVAL OR ENCAPSULATION PROJECT YOU MUST BE PREPARED AT ANY TIME TO SHOW THIS CARD TO AN INSPECTOR YOU CANNOT LET ANYONE ELSE USE THIS CARD. YOU MUST TAKE A REFRESHER COURSE BEFORE APPLYING FOR A RENEWAL OF THIS CARD

NOT VALID UNTIL SIGNED

Herbert J. Eslinger

THIS CERTIFIES THAT

HERBERT ESLINGER

has successfully completed the training needed to comply with AHERA regulations 40 CFR 763 and TSCA Title II. This course was held on 3/11/88 at the Northwest Envirocon, Inc. training center.

0158 3/11/88 RANDY HALL

The holder of this card has successfully completed the training needed to comply with AHERA regulations 40 CFR 763 and TSCA Title II.

Instructor Signature

Robert E. Hastings

Department of
LABOR & INDUSTRIESDivision of
INDUSTRIAL SAFETY & HEALTH**CERTIFIED ASBESTOS WORKER**

NAME
Herbert J Eslinger

CERTIFICATION NO. E6218	CERTIFICATE NO. 3042 W
BIRTHDATE 12/29/22	EXPIRATION DATE 03/25/90

ASBESTOS DEAF, Director
Joseph A. D.

Northwest Envirocon, Inc.



NAME
HERBERT J. ESLINGER

I.D.# CERT.#
MP-2107-88

BIRTHDATE EXP. DATE
12/29/22 05/06/89

CERTIFICATION TYPE
ACCREDITED MGT/PLANNER

The holder of this card has successfully completed the training needed to comply with AHERA regulations 40 CFR 763 and TSCA Title II.

Instructor Signature

Robert E. Hastings

Northwest ENVIROCON, Inc.

THIS CERTIFIES THAT

HERBERT ESLINGER

has successfully completed the training needed to comply with AHERA regulations 40 CFR 763 and TSCA Title II. This course was held on 3/11/88 at the Northwest Envirocon, Inc. training center.

0158 3/11/88 RANDY HALL

~~SECRET~~

~~SECRET~~

EXHIBIT 13-10 RECORDING FORM FOR ASSESSMENT DATA

Building: Travis Elementary

Functional Area No. 10-4-VT Location: Office in 7th grade classroom.

Type of Suspect Material: Surfacing, TSI, ☒ Other

Description: 9x9 tile

Approximate Amount of Material (linear or square ft.): 4100

Condition

Percent Damage: 5 %, Localized, Distributed

Type of Damage: Deterioration, Water, ☒ Physical

Description: _____

Overall Rating: ☒ Good, Fair, Poor

Potential for Disturbance

Accessibility: ☒ Accessible, Inaccessible

Description: _____

Potential for Contact: High, ☒ Moderate, Low

Description: _____

Influence of Vibration: High, Moderate, ☒ Low

Description: _____

Potential for Air Erosion: High, Moderate, ☒ Low

Description: _____

Located in a Plenum? Yes, ☒ No; Type: _____

Comments: _____

Signed: gc Date: 10-20-88

CERTIFICATE OF ANALYSIS

LAB I.D.: P-72011
 SAMPLE LOCATION: Fresno 10-4-VT
 COLLECTED BY: Client
 DATE COLLECTED: Not Given

DATE RECEIVED: November 2, 1988
 DATE STARTED: November 9, 1988
 DATE COMPLETED: November 9, 1988
 DATE REPORTED: November 11, 1988

CLIENT: Herbert Eslinger
 STREET: 9545 W. Hwy 152
 CITY: Dos Palos
 STATE: CA ZIP: 93620

PURCHASE ORDER: N/A
 OFW #: L0383
 COPY TO: No cc Req.

PLM ANALYSIS

Analyte	Results Volume 1	Detect Limit Volume 2
ASBESTOS		
CHRYSTILE	ND	1.
AMOSITE	ND	1.
CROCIDOLITE	ND	1.
ANTHOPHYLITE	ND	1.
TREMOLITE-ACTONOLITE	ND	1.
FIBER GLASS	ND	1.
MINERAL WOOL	ND	1.
CELLULOSE	ND	1.
NON FIBROUS MATERIALS	100. 2	

APPROVED: 

EX 31T 13-10 RECORDING FORM FO. ASSESSMENT DATA

Building: Elm Elementary

Functional Area No. 10-4-C Location: 7th grade classroom

Type of Suspect Material: Surfacing, TSI, ☒ Other

Description: ceiling 2x4'

Approximate Amount of Material (linear or square ft.): 9000

Condition

Percent Damage: 0 %, Localized, Distributed

Type of Damage: Deterioration, Water, Physical

Description: _____

Overall Rating: ☒ Good, Fair, Poor

Potential for Disturbance

Accessibility: Accessible, ☒ Inaccessible

Description: _____

Potential for Contact: High, Moderate, ☒ Low

Description: _____

Influence of Vibration: High, Moderate, ☒ Low

Description: _____

Potential for Air Erosion: High, Moderate, ☒ Low

Description: _____

Located in a Plenum? Yes, ☒ No; Type: _____

Comments: _____

Signed: ge Date: 10-20-88

CERTIFICATE OF ANALYSIS

LAB I.D.: P-72010
 SAMPLE LOCATION: Fresno 10-4-C
 COLLECTED BY: Client
 DATE COLLECTED: Not Given

DATE RECEIVED: November 2, 1988
 DATE STARTED: November 9, 1988
 DATE COMPLETED: November 9, 1988
 DATE REPORTED: November 11, 1988

CLIENT: Herbert Eslinger
 STREET: 9545 W. Hwy 152
 CITY: Dos Palos
 STATE: CA

ZIP: 93620

PURCHASE ORDER: N/A
 OFW #: L8383
 COPY TO: No cc Req.

PLM ANALYSIS

Analyte	Results Volume %	Detect Limit Volume %
ASBESTOS		
CHRYSDTILE	ND	1.
AMOSITE	ND	1.
CROCIDOLITE	ND	1.
ANTHOPHYLITE	ND	1.
TRENOLITE-ACTONOLITE	ND	1.
FIBER GLASS	ND	1.
MINERAL WOOL	ND	1.
CELLULOSE	93-95 %	
NON FIBROUS MATERIALS	5-7 %	

APPROVED: Scott Frost

OPERATIONS AND MAINTENANCE PROGRAM
(FORM D)

9

				CDS CODE 10-62166-6933691
SCHOOL Fresno SDA Academy <i>Elementary</i>				SCHOOL PHONE # (209)251-5548
ADDRESS	(number)	(street)	(city)	(zip code)
	5397	E. Olive Ave.	Fresno	93727

For each area where friable ACBM is present, assumed to be present, or is about to become present, write an operations and maintenance (O & M) program.

This O & M program must be developed for the entire school. The program must describe worker protection, initial and additional cleaning programs, building occupant protection (access control, signs, control of air movement, work practices, area cleaning, disposal methods), design and performance of other than small-scale, short-duration maintenance activities, and activities associated with minor and major fiber release episodes (Sec. 763.91).

IMPORTANT

Use Forms E through H to describe specific elements of this program. Use additional sheets when necessary.

All friable asbestos is found in the furnace room. The following procedures for cleaning should be followed. The ACBM in lines 5,6,& 7 of form B is nonfriable. Abstain from scraping, sanding, or anything that would cause the ACBM to become friable. If the condition changes and becomes friable, then the following steps will have to apply to them also.

INITIAL CLEANING:

Custodial Staff should:

Mop all non-carpeted floors with wet mops. Wipe all shelves and other horizontal surfaces with damp cloths. Use a mist spray bottle to keep cloths damp. Discard cloths and mop heads in sealed plastic bags according to EPA regulations for disposal of asbestos waste.

MONTHLY CLEANING:

Custodial Staff should:

Spray with water and debris found near surfacing ACM and place the debris in plastic bags using a dust pan. Rinse the pan with water in a utility sink. Report presence of debris immediately to the O&M Program Coordinator.

Wet-mop all other floors and wipe all other horizontal surfaces with damp cloths.

Dispose of all debris, filters, mop heads, and cloths in plastic bags according to EPA regulations for disposal of asbestos waste.

* Please note following page: "A GUIDE FOR REDUCING ASBESTOS EXPOSURE"

MONTHLY CLEANING:

Custodial Staff should:

Spray with water any debris found near surfacing ACM and place the debris in plastic bags using a dust pan. Rinse the pan with water in a utility sink. Report presence of debris immediately to the O&M Program Coordinator.

HEPA-vacuum all carpets.

Wet-mop all other floors and wipe all other horizontal surfaces with damp cloths.

Dispose of all debris, filters, mop heads, and cloths in plastic bags according to EPA regulations for disposal of asbestos waste.

The response action for any maintenance activities disturbing friable ACM, other than small-scale, short-duration maintenance activities, shall be designed by persons accredited to design response actions and conducted by persons accredited to conduct response actions.

The local education agency shall ensure that the procedures described below are followed in the event of a minor fiber release episode (i.e., the falling or dislodging of 3 square or linear feet or less of friable ACM):

- (1) Thoroughly saturate the debris using wet methods.
- (2) Clean the area with HEPA-vacuum or steam-clean carpets, HEPA-vacuum or wet-clean all other floors and all other horizontal surfaces.
- (3) Place the asbestos debris in a sealed, leak-tight container.
- (4) Repair the area of damaged ACM with materials such as asbestos-free spackling, plaster, cement, or insulation, or seal with latex paint or an encapsulant, or immediately have the appropriate response action implemented as required by Sec. 763.90.

The local education agency shall ensure that the procedures described below are followed in the event of a major fiber release episode (i.e., the falling or dislodging of more than 3 square or linear feet of friable ACM):

- (1) Restrict entry into the area and post signs to prevent entry into the area by persons other than those necessary to perform the response action.
- (2) Shut off or temporarily modify the air-handling system to prevent the distribution of fibers to other areas in the building.
- (3) The response action for any major fiber release episode must be designed by persons accredited to design response actions and conducted by persons accredited to conduct response actions.

A GUIDE FOR REDUCING ASBESTOS EXPOSURE

PURPOSE

Your school building contains materials which contain asbestos and may release fibers into the air. Breathing asbestos fibers is dangerous. This fact sheet tells how to reduce exposure to asbestos fibers. Please read it carefully.

PROTECTING YOURSELF FROM ASBESTOS

Some of the friable building materials in your school contain asbestos. Friable asbestos-containing materials crumble easily and release fibers into the air. Breathing these fibers may cause cancer and other diseases. The more asbestos you breathe, the greater your chances are of getting disease. You can take precautions that will reduce or eliminate the risk of being exposed to asbestos.

Find out from your supervisor where these friable asbestos-containing materials are in your building. Do not touch or disturb them unless you have to. If you must handle an asbestos-containing material, first lightly spray it with water, (EPA recommends using water which contains wetting agents, if they are available.) Wet asbestos-containing material will not release as many fibers.

Even if friable asbestos-containing materials are not disturbed, they may release asbestos fibers, which will fall slowly to the floor. If you are cleaning in areas which contain these materials, do not use a broom: it will stir the fibers into the air. Do not use a vacuum cleaner unless it is equipped with a High Efficiency Particulate Absolute filter. The fibers are so small they can pass through an ordinary vacuum cleaner and out into the room.

When cleaning in areas which contain friable asbestos-containing materials, use dampened mops and dustcloths. Dampened mops and dustcloths will hold the fibers much better than dry mops and dustcloths, and will reduce the number of fibers put back into the air. It is best to use mops with disposable heads and to throw away the mop head after use. Otherwise fibers will be released as the mop dries. Use either lightly dampened mops or cloths or a vacuum with a High Efficiency Particulate Absolute filter to clean areas where wet mopping cannot be used (such as carpeting or hardwood floors).

Clean tables and chairs in the area with damp cloths. Do not dust them with brushes or with dry cloths, and do not vacuum them.

After you use the mop heads and cloths, put them in a plastic bag while they are still wet. Dislodged materials should also be placed in plastic bags for disposal.

A LIST OF IMPORTANT POINTS TO REMEMBER

1. Do not handle or disturb friable asbestos containing materials unless necessary.
2. If you must handle asbestos-containing materials, wet them first.
3. If you must disturb asbestos (for example, to repair a light), see your supervisor before starting work. Then:
 - a. Place a plastic dropcloth below the work area.
 - b. Spray asbestos-containing material with water before you disturb it.
 - c. Make sure that only those persons who are necessary for the job are in the area.
 - d. Put all the asbestos you remove into a heavy plastic bag. Seal the bag and discard it.
 - e. After the job, clean all the ladders and tools you used with a wet cloth.
 - f. Roll up the dropcloth carefully and put it in a plastic bag. Discard the bag.
 - g. Clean the floor below the work area with a wet mop.
 - h. Put the mop head and the cloth used to clean the ladders in a plastic bag while they are still wet, seal the bag, and discard it.
4. If you must disturb or remove large sections of asbestos-containing material, see your supervisor before you begin. The National Institute for Occupational Safety and Health recommends that a respirator approved for toxic dusts be worn during such work.

You should make arrangements to turn off the school's ventilation system if you are disturbing or removing large sections of asbestos-containing material. The ventilation system should remain off until the work is completed and the area has been cleaned.

PERIODIC SURVEILLANCE PLAN
(FORM E)

9

				CDS CODE 10-62166-6933691
SCHOOL Fresno SDA Academy <i>Elementary</i>				SCHOOL PHONE # (209)251-5548
ADDRESS	(number)	(street)	(city)	(zip code)
	5397	E. Olive Ave.	Fresno	93727

This plan must include a periodic surveillance of each building with friable ACBM and nonfriable ACBM at least every six months. The person performing periodic surveillance must receive two hours general training and 14 hours of additional training if work performed might disturb asbestos. The person will record the date, the area of inspection, the inspector's name, the description of any changes of the materials, and also visual inspect the areas (Sec. 763.92).

Persons dealing with disturbed ACBM must have at least 16 hours of training in dealing and handling ACM. Inspection must be done every six months or by July 9, 1989 and every six months thereafter with a three year inspection by a certified state inspector or by July 9, 1992.

PERIODIC INSPECTION

Building inspectors should:

Inspect all ACM materials for damage or deterioration at least twice a year and report findings to the O&M program coordinator.

Investigate the source of debris found by the custodial staff.

Custodial and maintenance staff should:

Inform the O&M program coordinator when damage to ACM is observed or when debris is cleaned up.

NOTE the attached: "Reassessment of Asbestos-Containing Materials"
"Training and Periodic surveillance".

REASSESSMENT OF ASBESTOS-CONTAINING MATERIALS

Location of asbestos-containing material(s) (address, building, room(s), or general description: _____

Type of asbestos-containing material(s):

1. Sprayed or troweled on ceilings or walls.
2. Sprayed or troweled on structural members.
3. Insulation on pipes, tanks, or boilers.
4. Other (describe): _____

Abatement Status:

1. The material has been encapsulated _____, enclosed _____, neither _____.

Assessment:

1. Evidence of physical damage: _____
2. Evidence of water damage: _____
3. Evidence of delamination or other deterioration: _____
4. Degree of accessibility of the material: _____
5. Degree of activity near the material: _____
6. Location in an air plenum, air shaft, or air stream: _____
7. Other observations (including the condition of the encapsulant or enclosure, if any): _____

Signed: _____ Date: _____
(Evaluator)

Sec. 763.92 Training and periodic surveillance.

(a) *Training.* (1) The local education agency shall ensure, prior to the implementation of the O&M provisions of the management plan, that all members of its maintenance and custodial staff (custodians, electricians, heating/air conditioning engineers, plumbers, etc.) who may work in a building that contains ACBM receive awareness training of at least 2 hours, whether or not they are required to work with ACBM. New custodial and maintenance employees shall be trained within 60 days after commencement of employment. Training shall include, but not be limited to:

(i) Information regarding asbestos and its various uses and forms.

(ii) Information on the health effects associated with asbestos exposure.

(iii) Locations of ACBM identified throughout each school building in which they work.

(iv) Recognition of damage, deterioration, and delamination of ACBM.

(v) Name and telephone number of the person designated to carry out general local education agency responsibilities under Sec. 763.84 and the availability and location of the management plan.

(2) The local education agency shall ensure that all members of its maintenance and custodial staff who conduct any activities that will result in the disturbance of ACBM shall receive training described in paragraph (a)(1) of this section and 14 hours of additional training. Additional training shall include, but not be limited to:

(i) Descriptions of the proper methods of handling ACBM.

(ii) Information on the use of respiratory protection as contained in the EPA/NIOSH *Guide to Respiratory Protection for the Asbestos Abatement Industry*, September 1986.

(iii) Hands-on training in the use of respiratory protection, other personal protection measures, and good work practices.

(3) Local education agency maintenance and custodial staff who have attended EPA-approved asbestos training or received equivalent training for O&M and periodic surveillance activities involving asbestos shall be considered trained for the purposes of this section.

(b) *Periodic surveillance.* (1) At least once every 6 months after a management plan is in effect, each local education agency shall conduct periodic surveillance in each building that it leases, owns, or otherwise uses as a school building that contains ACBM or is assumed to contain ACBM.

(2) Each person performing periodic surveillance shall:

(i) Visually inspect all areas that are identified in the management plan as ACBM or assumed ACBM.

(ii) Record the date of the surveillance, his or her name, and any changes in the condition of the material.

(iii) Submit to the person designated to carry out general local education agency responsibilities under Sec. 763.84 a copy of such record for inclusion in the management plan.

REINSPECTION PLAN
(FORM F)

9

				CDS CODE 10-62166-6933691
SCHOOL Fresno SDA Academy <i>Elementary</i>				SCHOOL PHONE # (209)251-5548
ADDRESS	(number)	(street)	(city)	(zip code)
	5397	E. Olive Ave.	Fresno	93727

The plan must meet the reinspection requirements of Section 763.85. This plan will include a reinspection every three years by an accredited inspector.

The school must be reinspected in three years or by July 9, 1992 by a Certified Inspector, and every six months by a local inspector, documenting the conditions and state of ACM. Any changes must be documented, giving date of inspection and name of inspector.

Note: Please note the following page, REINSPECTION.

REINSPECTION;

1. At least once every 3 years after a management plan is in effect, each local education agency shall conduct a reinspection of all friable and nonfriable known or assumed ACBM in each school building that they lease, own, or otherwise use as a school building.
2. Each inspection shall be made by an accredited inspector.
3. For each area of a school building, each person performing a reinspection shall:

Visually reinspect, and reassess, under Sec. 763.88, the condition of all friable known or assumed ACBM.

Visually inspect material that was previously considered nonfriable ACBM and touch the material to determine whether it has become friable since the last inspection.

Identify and homogeneous areas with material that has become friable since the last inspection.

For each homogeneous area of newly friable material that is already assumed to be ACBM, bulk samples may be collected and submitted for analysis in accordance with Sec. 763.86 and 763.87.

Assess, under Sec. 763.88, the condition of the newly friable material in areas where samples are collected, and newly friable materials in areas that are assumed to be ACBM.

Reassess, under Sec. 763.88, the condition of friable known or assumed ACBM previously identified.

Record the following and submit to the person designated under Sec. 763.84 a copy of such record for inclusion in the management plan within 30 days of the reinspection:

1. The date of the reinspection, the name and signature of the person making the reinspection, State of accreditation, and if applicable, his or her accreditation number, and any changes in the condition of known or assumed ACBM.
2. The exact locations where samples are collected during the reinspection, a description of the manner used to determine sampling locations, the name and signature of each accredited inspector who collected the samples, State of accreditation, and, if applicable, his or her accreditation number.
3. Any assessments or reassessments made of friable material, the name and signature of the accredited inspector making the assessments, State of accreditation, and, if applicable, his or her accreditation number.

PARENT/EMPLOYEE NOTIFICATION PROGRAM
(FORM G)

10

				CDS CODE 10-62166-6933691
SCHOOL Fresno Adventist Elementary				SCHOOL PHONE # (209)251-5548
ADDRESS	(number)	(street)	(city)	(zip code)
	5397	E. Olive Avenue	Fresno	93727

In the discussion section of this form, information should be included that describes steps taken to inform workers and building occupants, or their legal guardians, about inspections, response actions, and post response action activities, including periodic reinspection and surveillance activities that are planned or in progress. Notifications must be made once each school year (Sec. 763.84).

Send a letter similar to the one enclosed to all parents, teachers, workers, and or legal guardian of all students. This letter must go out annually. A signed copy and every updated copy of this letter needs to be attached to this management plan. If your school does not contain ACBM this letter still needs to be sent out annually. Inform them that the school has been inspected for asbestos according with EPA regulations and a report is located at a centralized location at the administration office of the school and at the LEA's office for all to review. (Please note the attached form "Notice to School Employees".) This notification must remain until all ACBM is removed from the school. Please make sure your staff; teachers, workers, & custodial persons are aware of this report and where it can be found for review.

Dear Parents, Teachers, Workers, or Legal Guardians:

Our school has been inspected for asbestos containing building material (ACBM) according with EPA regulations. If you have any questions, please come in at your convenience and look over the management plan which is located at the administrative office here at the school and at the LEA's office in Clovis.

This report and all records regarding AHERA activities will be maintained at a centralized location and will be made available to you so that you can more fully understand what plans or actions are in progress concerning: inspections, response actions, post response action activities, periodic reinspection and surveillance activities.

Thank you for your continual support in christian education.

(Principal)

NOTICE TO SCHOOL EMPLOYEES

In accordance with EPA regulations, this school has been inspected for friable (easily crumbled) and non-friable materials which contain asbestos. Friable asbestos-containing material may cause health problems.

Friable and non-friable asbestos-containing material is present in

(Name of School)

A record of the inspection, a diagram of the location(s) of friable and non-friable asbestos-containing materials, and a copy of relevant EPA regulations are available in:

(building)

(room)

For further information, interested persons should call 800-424-9065 (554-1404 in the Washington, DC area).

Signed:

(Name)

(title)

Date

EVALUATION OF RESOURCES NEEDED
(FORM H)

10

					CDS CODE 10-62166-6933691
SCHOOL Fresno SDA Elementary					SCHOOL PHONE # (209)251-5548
ADDRESS	(number)	(street)	(city)	(zip code)	
	5397	E. Olive Ave.	Fresno	93727	
estimated total cost of response actions \$ 000.00		estimated total cost of inspections \$ 268.92		estimated total cost of management plan \$ 358.56	

Discussion should include such information as funding required, equipment, facilities, support personnel (Sec. 763.93).

FUNDING REQUIRED

40 CFR Part 763 Final Rule and Notice:

IV. Economic impact

The cost of an asbestos inspection is estimated to range from \$1,144 to \$1,627 per school for schools with both surfacing and thermal systems insulation ACM. This cost varies depending upon the size of the school, the amount and type of ACM contained in the school, and the type of professional doing the work. The costs of sampling and analysis if friable materials are found will depend upon the number of samples taken and analyzed. Costs of analysis are estimated to range from \$25 to \$47 per sample. Assuming the average school has an analyze 20 samples, the cost of analysis will be \$500 to \$940 per school. The cost of mapping ACM is estimated to range from \$110 to over \$270 per school.

The cost of developing a management plan is asbestos-containing surfacing ACM or thermal systems insulation ACM is present is estimated to range from \$1,025 for an average-size public primary school to \$1,420 for an average size public secondary school. These estimates are weighted average of the costs of plans developed by trained school personnel and by outside consultants.

The cost of training for school employees involves a variety of factors ranging from course and accreditation exam fees to the possible expenses for any out of town travel required for the training. The estimated course fee for a 2-hour awareness session required of all school maintenance employees in schools with ACM is approximately \$50 per person., The additional 14 hours of training for school maintenance workers who may come in contact with asbestos in doing minor repair and maintenance work that disturbs asbestos is estimated to cost \$250. A fee of \$420 is estimated for the 24 hours of training required for the certification of asbestos abatement workers doing more than just minor repair and small glove-bag removal jobs. The fee for the 40-hour training course and certification required for asbestos abatement contractors is estimated to be \$640.

Response action costs depend primarily on the condition of the asbestos in a school and to a lesser extent on many other factors. In general, for surfacing ACM in all but the significantly damaged category, it is likely that the primary response action undertaken by a school will be special O&M activities. Use of O&M activities would likely continue until or unless the ACBM deteriorates to a "significantly damaged" condition. The annual cost of a special O&M program (excluding acquisition of special equipment) is estimated to range from \$3,800 for a typical public primary school to \$5,100 for a typical public secondary school. Initial cleaning costs are expected to range from \$950 to \$1,400.

The cost of removal depends upon many factors including size of the project. The estimated cost of removal for a 4,000 sq. ft. project in which surfacing material is removed would be approximately \$51,300. The cost of removal for a 900 sq. ft. boiler wrap project is estimated to be approximately \$30,900. The total discounted costs of response actions were estimate assuming schools undertake a combination of response actions that depend on the condition of the ACM.

EQUIPMENT

For handling small removal jobs of 32 sq. ft. or less or cleaning of ACBM, the following will be needed:

- Gloves
- Glove bags (depending on the type of removal)
- Tyvecs (disposable coveralls)
- Negative air mask respirator
- Nepa-filter vacuum cleaner
- Plastic sheeting
- Plastic bags ("Danger-Asbestos")

For more information about Asbestos safety order:

ENVIRONMENTAL PROTECTION AGENCY (EPA)

General Asbestos Info: Library: (415) 974-8076

Technical Assistance: Schools: (415) 974-7551, -7056

NESHAP for removal & demolition regulations, for contractors, building owners:

1. Local Air Pollution Control (delegated local authority for NESHAP regs.)

Bay Area: (F.S. Alameda, Contra Costa, Marin, Napa, San Mateo, Santa Clara, Sonoma & Solano): (415) 771-6000

Other counties: "name of county Air Pollution Control District".

2. Emergency Notifications: Local APCD (above) and Janet Crawford, EPA NESHAPs Coordinator: (415) 974-7633

CONSULTANT list: 1. In phone books under "Industrial Hygienists of Asb. Consultants"

2. By calling American Lung Association for their list

a. San Francisco Office: (415) 543-4410

b. Los Angeles Office: (213) 935-5864

3. Listed in "American Indust. Hygiene Assoc. Journal" in January ;and July issues: (216) 762-7294

4. Pamphlet: ASBESTOS SAFETY EQUIPMENT

100 Gall Drive Suite #4

Novato, Ca. 94949

ph. (415) 892-9359

FACILITIES

Disposal Waste Dumps:

Berkeley: (415) 540-2043

Sacramento: (916) 739-3145

Fresno: (209) 445-5938

Contact Mr. Milton Thorman, (209) 291-7700, for information about the nearest drop sight for all your asbestos.

SUPPORT PERSONNEL

PACIFIC ASBESTOS INFORMATION CENTER: UC Berkeley Ext. courses: (415) 643-7143

OSHA: Worker Protection, enforcement and Industrial Hygiene consultation:

Federal OSHA: Toll free general info: (800) 648-1003

CAL/OSHA: Clovers State employees only: gen. consultation: (415) 557-1946

AHERA; For management of AHERA regulations, to provide lists of accredited persons, to receive the Management plans: California: (916) 445-9327.

NESHAPS: National Emissions Standards for Hazardous Air Pollutants regulates the emission of asbestos fibers for handling of asbestos in most buildings, and the disposal of asbestos-containing waste. The EPA/NESHAPS must be notified before the beginning of any project of more than 160 sq. ft. or 260 linear feet. Notify by mail to Ms. Janet Crawford A-3-3, NESHAPS Coordinator, NESHAPS A-3-3. EPA Region 9, 215 Fremont St. S.F., CA., 94105.

Air pollution Control District (APCD): These local agencies have been delegated primary authority to enforce EPA/NASHAP regulations. Contract the nearest county agency for information and notification requirements for asbestos projects.

BAAQMD: 415) 771-6000.

The following providers have either full or contingent approval in Region 9. Successful completion of either a fully approved course or a contingently approved course provides full accreditation for course attendees. Only if EPA subsequently withdrew contingent approval would future course offering not have EPA approval.

- * ABMS/Excel Environ. Inc., Oakland, CA (415) 547-7144. Contingent approval: Workers; Contractor/Supervisors
- * Center for Accelerated Learning, Vacaville, CA. (707) 446-7996. Contingent approval: Contractor/Supervisors; Workers.
- * Insulators and Asbestos Industry of Northern California, Alameda, CA. (415) 522-7048.
- * IT Corp., Wilmington, CA. (213) 830-1781. Contingent approval: Workers; Contractor/Supervisors
- * Kellico, Fremont, CA. (415) 659-9751. Contingent approval: Workers.
- * Med-Tox, Tusting CA. (714) 259-0620. Contingent approval; Inspector; Contractor/Supervisor; Workers.

* Napier & Associates, Torrance, CA. (213) 644-1924. Contingent approval:
Workers.

* Pacific Asbestos Information Center, Berkeley Extension, CA. (415) 643-7143.
Full approval: Inspector/Management planner; Contractor/Supervisor.

EPA-ACCREDITED COURSES FROM OTHER REGIONS AVAILABLE IN CALIFORNIA

Telephone providers for schedules and information.

* Clayton Envir. Conslt.
(415) 426-2600
Inspector/Mgmt.Planner

* Kaselaan & D'Angelo Assoc.
(213) 324-6825
Inspector/Mgmt.Planner

* Critical Environmental
Training, Texas:
(800) 527-1830
Contractor/Supervisor; Workers

* Local 22, Texas
Internt. Assoc. Of Heat & Frost
(713) 473-0888
Contractor/Supervisor, Workers

* Environmental Instit., Texas
(214) 553-8866
Inspector/Mgmt. Planner
Contractor/Supervisor

* NAC (National Asb. Council)
(404) 292-0629
Workers

* Hall-Kimbrell, Kansas
(800) 364-2860
Contractor/Supervisor,
Workers, Project Designer

* North West Envirocon, Or.
(503) 659-8899
Inspector/Mgmt.Planner

* IPC, Illinois
(312) 975-3495
Workers

* White Lung, Maryland
(415) 668-2594
(707) 839-9270
Inspector/Mgmt.Planner

RECORDKEEPING

REQUIREMENT

All records shall be maintained in a centralized location in the administrative office of both the school and the local education agency as part of the management plan. For each homogeneous area where all ACBM has been removed, the local education agency shall ensure that such records are retained for 3 years after the next reinspection required under Sec. 763.85 or for an equivalent period.

For each preventive measure and response action taken for friable and nonfriable ACBM and friable and nonfriable suspected ACBM assumed to be ACM, the local education agency shall provide;

(1) A detailed written description of the measure or action, including methods used, the location where the measure or action was taken, reasons for selecting the measure or action, start and completion dates of the work, names and addresses of all contractors involved, and if applicable, their State of accreditation, and accreditation numbers, and if ACBM is removed, the name and location of storage or disposal site of the ACM.

(2) The name and signature of any person collecting any air sample required to be collected at the completion of certain response actions specified by Sec. 763.90, the locations where samples were collected, date of collection, the name and address of the laboratory analyzing the samples, the date of analysis, the results of the analysis, the method of analysis, the name and signature of the person performing the analysis, and a statement that the laboratory meets the applicable requirements of Sec. 763.90.

For each person required to be trained under Sec. 763.92 (a) 1 & 2, the local education agency shall provide the person's name and job title, the date that training was completed by that person, the location of the training, and the number of hours completed in such training.

For each time that periodic surveillance under Sec. 763.92 (b) is performed, the local education agency shall record the name of each person performing the surveillance, the date of the surveillance, and any changes in the conditions of the materials.

For each time that cleaning under Sec. 763.91 (c) is performed, the local education agency shall record the name of each person performing the cleaning, the date of such cleaning, the locations cleaned, and the methods used to perform such cleaning.

For each time that operations and maintenance activities under Sec. 763.91(d) are performed, the local education agency shall record the name of each person performing the activity, the start and completion dates of the activity, the locations where such activity occurred, a description of the activity including preventive measures used, and if ACBM is removed, the name and location of storage or disposal site of the ACM.

For each time that major asbestos activity under Sec. 763.91 (e) is performed, the local education agency shall provide the name and signature, State of accreditation, and if applicable, the accreditation number of each person performing the activity, the start and completion dates of the activity, the locations where such activity occurred, a description of the activity including preventive measures used, and if ACBM is removed, the name and location of storage or disposal site of the ACM.

For each fiber release episode under Sec. 763.91 (f), the local education agency shall provide the date and location of the episode, the method of repair, preventive measures or response action taken, the name of each person performing the work, and if ACBM is removed, the name and location of storage or disposal site of the ACM.

PERMIT APPLICATION FOR PERFORMING MAINTENANCE/RENOVATION WORK

1. Exact location of area involved (including building number, room number, location within room, etc.) _____

2. Description of work involved _____

3. Starting Date _____ Anticipated Completion Date _____
4. * Approximate amount of asbestos present (linear feet, square feet, size of tank, etc.) _____

5. * Asbestos control methods to be used (i.e., glove bag, HEPA vacuum, wet methods, etc.) _____

6. * Protective equipment to be used (respirator, coveralls, etc.) _____

7. Name and telephone number/extension of supervisor. _____

TO BE FILLED OUT BY ASBESTOS PROGRAM MANAGER

Permit _____ Accepted _____ Rejected _____
Signed _____ Print _____
Permit Number _____
Emergency Contact _____

Please return this form to:

Eslinger's Enterprise
9535 Arroya Rd.
Dos Palos, Ca. 93620

* Note; These items may have to be filled out by asbestos program manager.

FIBER RELEASE EPISODE REPORT

1. Address, building, and room number(s) (or description of area) where episode occurred: _____

2. The release episode was reported by _____
on _____ (date)
3. Describe the episode: _____

4. The asbestos-containing material was _____/ was not _____
cleaned up according to approved procedures. Describe the cleanup:

Signed: _____
(Asbestos Program Manager)

Date: _____